

PROPOSED RESIDENCE AND GARAGE

LOT 1539, 11 FENWICK STREET, TARNEIT 3029

GENERAL NOTES

THESE DRAWINGS ARE TO BE READ IN CONJUNCTION WITH ACCOMPANYING PROJECT AND GENERAL SPECIFICATIONS, ENGINEERS, SOIL REPORT ETC WHERE APPLICABLE. ALL DIMENSIONS AND LEVELS ARE TO BE CHECKED AND VERIFIED BY THE OWNER/BUILDER, AND ANY DISCREPANCIES IN THE DOCUMENTS MUST BE RESOLVED BEFORE ORDERING OR COMMENCEMENT OF ANY WORKS. THE DRAWINGS CONTAINED HERE WITHIN ARE TO BE READ & CONFIRMED IN FULL PRIOR TO CONSTRUCTION. NO RESPONSIBILITY SHALL BE TAKEN IF INFORMATION SUPPLIED IS INCORRECT OR INCOMPLETE BEYOND THE COMMENCEMENT OF WORKS. THESE DRAWINGS ARE NOT TO BE SCALED. USE WRITTEN DIMENSIONS ONLY.

SITE CLASSIFICATIONS.

THESE PLANS SHALL BE READ IN CONJUNCTION WITH ANY STRUCTURAL OR CIVIL ENGINEERING COMPUTATIONS AND DRAWINGS.
SOIL CLASSIFICATION, CLASS 'M', REFER SOIL REPORT ST-43646, BY GEO-CORE PTY LTD.

CODES AND REGULATIONS

ALL WORK AND MATERIALS SHALL CONFORM TO CURRENT AUSTRALIAN STANDARDS, AND TO THE BUILDING CODE OF AUSTRALIA.
THE BUILDER SHALL CONFIRM IN ALL RESPECTS TO LOCAL COUNCIL REQUIREMENTS, THE B.C.A AND RELEVANT S.A.A.

STRUCTURAL STEEL

ALL STRUCTURAL STEEL SHALL BE MILD STEEL TO AS3678 AND DESIGNED IN ACCORDANCE WITH AS4100 UNLESS OTHERWISE NOTED ON DRAWINGS. STRUCTURAL STEEL HOLLOW SECTIONS SHALL BE COLD FORMED STEEL, MANUFACTURED TO AS1163 HAVING YIELD STRENGTH OF 350 MPA AND DESIGNED IN ACCORDANCE WITH AS1538. ALL EXPOSED STEELWORK TO BE HOT DIPPED GALVANISED TO S.A.A.

TIMBER AND FRAMING

PERFORMANCE REQUIREMENTS P2.1 IS SATISFIED FOR A TIBER FRAME IF IT IS DESIGNED AND CONSTRUCTED IN ACCORDANCE WITH EITHER AS1684.2 RESIDENTIAL TIMBER FRAMED CONSTRUCTION NON CYCLONIC AREAS OR AS1684.4-RESIDENTIAL TIMBER FRAMED CONSTRUCTION - SIMPLIFIED NON CYCLONIC AREAS.

BRICKWORK

CLAY BRICKS SHALL BE USED IN ACCORDANCE WITH AS 3700 AND SHALL A MINIMUM COMPRESSIVE STRENGTH OF 30 MPA. MORTARS SHALL BE MIXED IN PROPORTIONS OF 1 PART PORTLAND CEMENT, 1 PART HYDRATED LIME OR LIME PUTTY AND 6 PARTS FINE AGGREGATE VOLUME BATCHED. TO ALL BRICK WALLS PROVIDE 3MM STAINLESS STEEL TIES PLACED NOT FURTHER APART THEN 460MM X 610MM CENTRES SLOPING DOWNWARDS TO THE OUTSIDE.
PROVIDE ARTICULATION OR EXPANSION JOINTS AT 6.0M CTRS MAX. AND NOT EXCEEDING 3.0M FROM ANY CORNER, AND AS PER SOIL REPORT RECOMMENDATIONS.

GLAZING

PERFORMANCE REQUIREMENTS P8.1 AND P8.2 ARE SATISFIED FOR GLAZING AND WINDOWS IF DESIGNED AND CONSTRUCTED IN ACCORDANCE WITH AS2047 FOR THE GLAZED ASSEMBLIES IN EXTERNAL WALLS LISTED IN NCC 2022-8.1.1
PERFORMANCE REQUIREMENTS P3.6 IS SATISFIED FOR GLAZING IF DESIGNED AND CONSTRUCTED IN ACCORDANCE WITH AS1288 FOR ALL GLAZED ASSEMBLIES OUTSIDE OF STANDARD PRACTICE AND LISTED IN NCC 2022-8.1.2

PERFORMANCE REQUIREMENT P 8.1 FOR GLAZING IS SATISFIED PROVIDED THE BUILDING IS LOCATED IN AN AREA WITH A DESIGN WIND SPEED OF NOT MORE THAN N3, GLASS IS A TYPE RECOGNIZED BY AS1288, SAFETY GLAZING IS LEGIBLY MARKED IN ACCORDANCE WITH AS1288, GLAZING USED IN BALUSTRADES COMPLIES WITH AS1288, SAFETY GLAZING IS MADE VISIBLE IN ACCORDANCE WITH NCC 2012-8.4.7, THE GLAZING IS NOT FOR ONE OF THE ASSEMBLIES LISTED IN NCC 2022-8.4.7 AND THE GLAZING IS FOR ALL ASSEMBLIES OUTSIDE OF STANDARD PRACTICE AND LISTED IN NCC 2022-8.4.8.

STAIRS CONSTRUCTION

STAIRWAYS MUST BE DESIGNED IN ACCORDANCE WITH PART 11.2 of the NCC 2022 AND THE LOADING FORCES OF STAIRWAYS MUST BE IN ACCORDANCE WITH AS/NZS 1170.1.

EACH STAIRCASE MUST NOT HAVE MORE THAN 18 AND NOT LESS THEN 2 RISERS IN EACH FLIGHT. RISER & GOING DIMENSIONS.
THE FOLLOWING DIMENSIONS ARE COMPLIANT FOR STAIRCASES EXCLUDED SPIRAL STAIRS:
-RISERS (R) 190mm MAXIMUM AND 115 MINIMUM.
-GOING (G) 355mm MAXIMUM AND 240mm MINIMUM.
-2R + 1G = 700mm MAXIMUM AND 550mm MINIMUM.
A 125mm SPHERE MUST NOT BE ABLE TO PASS THROUGH THE TREADS OR BALUSTRADE.
ALL GOINGS AND RISERS THROUGHOUT A STAIRCASE MUST BE CONSISTANT.

WET AREAS

PERFORMANCE REQUIREMENTS P10.2 IS SATISFIED FOR WET AREAS IN CLASS 1 AND 10 BUILDINGS IF THEY ARE WATERPROOF OR WATER RESISTANT IN ACCORDANCE WITH AS 3740- WATERPROOFING OF WET AREAS IN RESIDENTIAL BUILDINGS.
PERFORMANCE REQUIREMENT P10.2 IS SATISFIED FOR WET AREAS PROVIDED THE WET AREA IS PROTECTED IN ACCORDANCE WITH THE APPROPRIATE REQUIREMENTS OF NCC 2022-10.2.6 to 10.2.27 AND COMPLIES WITH THE APPROPRIATE DETAILS DESCRIBED IN NCC 2022 Figures 10.2.2

INSULATION

UNLESS NOTED OTHERWISE, THE FOLLOWING INSULATION IS TO BE PROVIDED FOR THE FOLLOWING TYPES OF FLOOR:
TILED ROOF : REFER TO ENERGY RATING REPORT. EXT.WALLS : REFER TO ENERGY RATING REPORT.
ANY SARKING TYPE MATERIAL MUST HAVE A FLAMMABILITY INDEX OF NOT MORE THAN 5.

SLAB

PERFORMANCE REQUIREMENTS P4.1 & 4.2 ARE SATISFIED FOR FOOTING & SLABS IF THEY ARE INSTALLED WITH AS 2870 or AS 2159 FOR PILED FOOTINGS.

A VAPOUR BARRIER MUST BE 0.2mm NOMINAL THICKNESS POLYETHYLENE FILM AND MEDIUM IMPACT RESISTANT DETERMINED FROM CRITERIA SPECIFIED IN CLAUSE 5.3.3.2(c) OF AS 2870 AND BE BRANDED CONTINUOUSLY "AS 2870 CONCRETE UNDERLAY, 0.2mm MEDIUM.
A VAPOUR BARRIER MUST BE INSTALLED SO THAT IT DOES NOT LAP ANY LESS THAN 200mm AT ALL JOINTS, ALL SERVICE PENETRATIONS HAS A TAPE OR SEAL WITH A CLOSE FITTING SLEEVE AROUND IT AND BE FULLY SEALED WHERE PUNCTURED (UNLESS FOR SERVICE PENETRATIONS) WITH ADDITIONAL POLYTHYLENE FILM & TAPE.

THE VAPOUR BARRIER MUST BE PLACED BENEATH THE SLAB SO THAT THE BOTTOM SURFACE OF THE SLAB IS ENTIRELY UNDERLAID AND EXTENDS UNDER THE EDGE BEAMS TO FINISH AT GROUND LEVEL IN ACCORDANCE WITH NCC 2022-Figure4.2.8..

CONCRETE STUMPS
-100MM SQ UP TO 1400MM LONG (1 No H.D. WIRE)
-100MM SQ 1401MM TO 1800MM LONG (2 No H.D. WIRES)
-125MM SQ 1801MM TO 3000MM LONG (2 No H.D. WRES)
NOTE ALL STUMPS EXCEEDING 1200MM ABOVE GROUND TO BE odate this BRACED.

SMOKE ALARMS

SMOKE ALARM DETECTORS, HARD WIRED TO SWITCH BOARD TO CONFORM WITH AS 3786.
THERMAL PERFORMANCE
PROPOSED DWELLING MUST BE CONSTRUCTED TO MINIMIZE AIR LEAKAGES VIA ROOF, EXTERNAL WALLS, FLOORS AND OPENINGS SUCH AS WINDOWS, DOORS AND THE LIKE.
DRAFTS MUST BE RESTRICTED VIA EXHAUST FANS, CHIMNEYS, FLUES, OPENABLE WINDOWS AND OTHER SUCH OPENINGS MUST BE FITTED WITH A SEAL WHERE PRACTICAL TO RESTRICT AIR INFILTRATION. (SEALS MUST BE CONSTRUCTED FROM A FOAM OR RUBBER COMPRESSIBLE STRIP, FIBROUS SEAL OR THE LIKE).
WHEN SERVICING A CONDITIONED SPACE, ALL ROOF LIGHTS MUST BE SEALED OR HAVE THE CAPABILITY OF BEING SEALED.
ALL WINDOWS ARE ASSUMED TO MEET AS2047 (CLAUSE 2.1.3.5) AND AS4420.4 ON AIR INFILTRATION.
CHECK BEFORE ORDERING.

THE OWNER/BUILDING SHALL ENSURE THAT ALL WORKS AND MATERIALS USED SHALL BE TO THE APPROVAL OF THE RELEVANT STATUTORY AUTHORITIES AND CONFORM TO THE BUILDING CODE OF AUSTRALIA'S A.S. CODES (CURRENT EDITIONS), BUILDING REGULATIONS, LOCAL BY-LAWS AND TOWN PLANNING REQUIREMENTS.

ALL WORK TO BE IN ACCORDANCE WITH THE CONDITIONS SET OUT BY WESTERN WATER

LOCAL AUTHORITY : MELTON CITY COUNCIL
COUNCIL PROPERTY INFORMATION SHOULD BE READ AND UNDERSTOOD PRIOR TO CONSTRUCTION

THE BUILDER IS TO VERIFY ALL LEVELS AND DIMENSION ON SITE PRIOR TO CONSTRUCTION.
THIS DRAWING IS PROTECTED BY COPY-RIGHT AND ANY BREACH OR INFRINGEMENT OF COPY-RIGHT WILL RESULT IN COURT PROCEEDINGS.

RAMPS

RAMPS MUST COMPLY WITH CLAUSE 11.2..3 of the NCC 2022 AND BE DESIGNED TO TAKE LOADING FORCES IN ACCORDANCE WITH AS/NZS 1170.1.
RAMPS MUST NOT HAVE A STEEPER GRADIENT THAN 1:8.

BARRIERS & HANDRAILS.

A CONTINUOUS BARRIER MUST BE PROVIDED ALONG THE SIDE OF ANY OF THE FOLLOWING AS PER CLAUSE 11.3.3 of the NCC 2022;
-STAIRWAY OR RAMP;
-A FLOOR, CORRIDOR, HALLWAY, BALCONY, DECK, VERANDAH, MEZZANINE, ACCESS BRIDGE OR THE LIKE IF THE TRAFFICABLE SURFACE IS 1M OR MORE ABOVE THE SURFACE BENEATH.

THE HEIGHT OF BARRIERS MUST NOT BE ANY LESS THAN 865mm ABOVE THE NOSINGS OF THE STAIR TREADS OR THE FLOOR OF A RAMP AND MUST NOT BE ANY LESS THAN 1M ABOVE THE FLOOR OF ANY ACCESS PATH, BALCONY, LANDING OR THE LIGHT.

WHERE A REQUIRED BARRIER IS CONSTRUCTED OF WIRE IT IS TO COMPLY WITH CLAUSE 11.3.4.


STORMWATER.

THE POSITION AND MANNER OF DISCHARGE OF THE STORMWATER DRAINAGE SYSTEM MUST BE TO THE SATISFACTION OF THE APPROPRIATE AUTHORITY.

THE STORMWATER DRAINAGE SYSTEM MUST BE DESIGNED SO THAT ANY OVERFLOW DURING HEAVY RAINS\ PERIODS IS PREVENTED FROM FLOWING BACK INTO THE BUILDING.

THE BUILDER AND SUBCONTRACTOR SHALL ENSURE THAT ALL STORMWATER DRAINS, SEWER PIPES AND THE LIKE ARE LOCATED AT A SUFFICIENT DISTANCE FROM ANY BUILDING FOOTING AND/OR SLAB EDGE BEAMS SO AS TO PREVENT GENERAL MOISTURE PENETRATION, DAMPNESS, WEAKING AND UNDERMINING OF ANY BUILDING AND ITS FOOTING SYSTEM.

REVISIONS:



Please note: Grade surface away from the Building to a minimum distance of 1.0 metres at a 1 in 20 minimum fall, and collect all stormwater runoff via a PVC channel or spoon drain and connect to SMD.
SURFACE DRAIN

GURU BUILDING GROUP

Address: UNIT 7
133-143 ELGAR ROAD, DERRIMUT
email: admin@gurubuildinggroup.com.au
Phone: 0405402789

PROJECT: PROPOSED RESIDENCE & GARAGE		CLIENT: AVISTA HOMES	
ADDRESS: LOT 1539, 11 FENWICK STREET, TARNEIT 3029			
DRAWING STATUS: WORKING DRAWING	TITLE: NOTES	ISSUE: 1	DRAWN: DATE 19/04/24
			CHECKED: PAGE 1
			DRW. NUMBER: 20459

PROPOSED RESIDENCE AND GARAGE

LOT 1539,11 FENWICK STREET, TARNEIT 3029

TERMITE PROTECTION.

WHERE THE BUILDING (EXCLUDES A DETACHED CLASS 10) IS LOCATED IN A TERMITE PRONE AREA, THE AREA TO UNDERSIDE OF BUILDING & PERIMETER IS TO BE TREATED AGAINST TERMITE ATTACK.

A TERMITE BARRIER OR COMBINATION OF BARRIERS MUST BE INSTALLED IN ACCORDANCE WITH AS 3660.01 or NCC 2022-3.4.2 FOR CONCRETE SLABS ON GROUND OR NCC 2022-3.4.2 FOR A SUSPENDED FLOOR. FOR BARRIER OPTIONS REFER TO NCC 2022-Table 3.4.2.

m CONCRETE.

CONCRETE MUST BE MANUFACTURED TO COMPLY WITH AS 3600 AND HAVE A STRENGTH AT 28 DAYS OF NOT LESS THAN 20MPa (DENOTED AS N20 GRADE), HAVE A 20mm NOMINAL AGGREGATE AND HAVE A NOMINAL 80mm SLUMP

SUB FLOOR VENTILATION.

SUB-FLOOR VENTS TO PROVIDE A RATE OF 7500mm SQ CLEAR VENTILATION PER 1000MM SQ RUN OF EXTERNAL MASONRY WALL AND 2200MM SQ CLEAR VENTILATION PER 100MM RUN OF INTERNAL DWARF WALLS.

WALL TIES.

MASONRY WALL TIES MUST BE USED IN ACCORDANCE WITH NCC 2022-5.6.5 WHERE ARTICULATION JOINTS OCCUR IN MASONRY WALLS, TIES MUST BE BUILT IN BOTH SIDES OF THE JOINT AND SPACED NOT MORE THAN 300mm FROM THE JOINT, SEE NCC 2022-Figure 3.3.3.1.

TIES FOR SOLID OR MONOLITHIC CONSTRUCTION MUST BE MEDIUM DUTY CLASSIFICATION SPACED NOT MORE THAN 400mm IN EACH DIRECTION AND MUST BE IN ACCORDANCE WITH NCC 2022-5.6.5.

STEEL LINTELS.

LINTELS IN MASONRY MAY BE ANY OF THOSE SPECIFIED IN NCC 2022-5.6.7.

DAMP PROOF COURSE.

DAMP PROOF COURSES MUST CONSIST OF EITHER A MATERIAL THAT COMPLIES WITH AS/NZS 2904, AN EMBOSSED BLACK POLYETHYLENE FILM OF HIGH IMPACT RESISTANCE AND LOW SLIP WITH A NOMINAL THICKNESS OF 0.5mm PRIOR TO EMBOSSING AND MEETING THE REQUIREMENTS OF CLAUSE 7.6 of AS/NZS 2904 or: A POLYETHYLENE COATED METAL, THAT HAS A ALUMINIUM CORE OF NOT LESS OF 0.1mm THICK, IS COATED BOTH SIDES WITH BITUMEN ADHESIVE INCLOSED IN POLYETHYLENE FILM OF NOT LESS THAN 0.5mm PRIOR TO EMBOSSING or: A BITUMEN IMPREGNATED MATERIAL OF NOT LESS THAN 2.5mm THICKNESS THAT MEETS THE REQUIREMENTS OF CLAUSE 7.5 OF AS/NZS 2904 WHEN USED IN WALLS WHICH ARE NOT HIGHER THAN 7.8m ABOVE THELEVEL OF THE DPC OR A TERMITE SHIELD (WITH NOT PENETRATIONS) CONTINUOUS THROUGH THE WALL or PIER.

FIRE SEPARATION.

FIRE SEPARATION IN ACCORDANCE WITH NCC 2022-9.

WALL CLADDING.

IN ORDER TO SATISY PERFORMANCE REQUIREMENTS P2.1 AND P2.2.2, WALL CLADDING MUST COMPLY WITH NCC 2022-7.4.

ROOF TILING.

ROOF TILES, COMPLYING WITH AS2049, MUST BE INSTALLED, FIXED AND FLASHED IN ACCORDANCE WITH THE RELEVANT PROVISIONS OF NCC 2022-7.3.2.

ROOF TILES WITH A PITCH NOT MORE THAN 35 DEGREES MUST BE FIXED IN ACCORDANCE WITH NCC 2022-Figure 7.3.2

FIXINGS FOR ROOF BATTENS AND BATTEN SIZES MUST COMPLY WITH NCC 2022-7.3.2.

ALL TILED ROOF FLASHINGS, RIDGE AND HIP TILES MUST BE INSTALLED IN ACCORDANCE WITH NCC 2022-Figure 7.2.7

LEAD FLASHINGS MUST NOT BE USED ON ANY ROOF THAT IS PART OF A POTABLE WATER CATCHMENT AREA.

METAL SHEET ROOFING.

THE DESIGN AND INSTALLATION OF SHEET METAL ROOFING MUST COMPLY WITH THE RELEVANT PROVISIONS OF NCC 2022-7.2.

METAL SHEET ROOFING MUST BE PROTECTED FROM CORROSION IN ACCORDANCE WITH NCC 2022-Table: 7.2.2a.

WHERE DIFFERENT METALS ARE USED IN A ROOFING SYSTEM, ENSURE COMPATIBLE WITH EACH OTHER (TO PREVENT CORROSION DUE TO AN ADVERSE CHEMICAL REACTION) AS DESCRIBED IN NCC 2022-Table 7.2.2. ALSO NO LEAD MATERIALS CAN BE USED UPSTREAM FROM ZINC-ALUMINIUM COATED MATERIALS AND NO COPPER MATERIALS CAN BE USED UPSTREAM FROM GALVANISED COATED MATERIALS.

SHEET METAL ROOF FLASHINGS MUST AND CAPPINGS MUST COMPLY WITH NCC 2022.7.2.3

FLASHING OF PENETRATIONS MUST COMPLY WITH NCC 2022-7.2.3)

GUTTERS & DOWN PIPES.

GUTTERS, DOWN PIPES AND FLASHINGS MUST BE MANUFACTURED IN ACCORDANCE WITH AS/NZS 2179.1 FOR METAL, BE MANUFACTURED IN ACCORDANCE WITH AS 1273 for UPVC COMPONENTS, BE COMPATIBLE WITH ALL UPSTREAM ROOFING MATERIALS IN ACCORDANCE WITH 7.2.3 AND NOT CONTAIN ANY LEAD IF USED ON A ROOF FORMING PART OF A POTABLE WATER CATCHMENT AREA.

GUTTERS MUST BE INSTALLED WITH A FALL OF NOT LESS THAN 1:500 FOR EAVES GUTTERS, UNLESS FIXED TO METAL FASCIAS AND 1:100 FOR BOX GUTTERS. EAVE GUTTERS MUST BE SUPPORTED BY BRACKETS SECURELY FIXED AT STOP ENDS AND AT MORE THAN 1.2m CENTRES.

DOWN PIPES MUST NOT SERVE MORE THAN 12m OF GUTTER LENGTH FOR EACH DOWNPIPE, MUST BE LOCATED AS CLOSE AS POSSIBLE TO VALLEY GUTTERS AND IF THE DOWNPIPE IS MORE THAN 1.2m FROM A VALLEY, PROVISION FOR OVERFLOW MUST BE MADE TO THE GUTTER AND DOWNPIPES MUST BE SELECTED IN ACCORDANCE WITH THE APPROPRIATE EAVES GUTTER SECTION AS SHOWN IN NCC 2022-Table 7.4.6

SOUND INSULATION.

WHERE A SEPERATING WALL IS CONSTRUCTED BETWEEN TWO OR MORE CLASS 1 BUILDINGS IT MUST BE CONSTRUCTED TO A STANDARD AS PER PART 3.8.6 OF THE NCC 2022 TO AVOID UNDUE SOUND TRANSMISSION BETWEEN THE TWO DWELLINGS.

NATURAL LIGHTING.

NATURAL LIGHTING MUST BE PROVIDED IN A CLASS 1 BUILDING TO ALL HABITABLE ROOMS IN ACCORDANCE WITH THE FOLLOWING; NATURAL LIGHTING MUST BE PROVIDED BY WINDOWS THAT HAVE AN AGGREGATE LIGHT TRANSMITTING AREA MEASURED EXCLUSIVE OF FRAMING MEMBERS, GLAZING BARS OR OTHER OBSTRUCTIONS OF NOT LESS THAN 10% OF THE FLOOR AREA OF THE ROOM AND ARE OPEN TO SKY OR FACE A COURT OR OTHER SPACE OPEN TO THE SKY OR AN OPEN VERANDAH, CARPORT OR THE LIKE INCLUDING ROOF LIGHTS.

A HABITABLE ROOM WINDOW FACING BOUNDARY OF ADJOINING PROPERTY MUST NOT BE LESS THAN 900mm FROM THE BOUNDARY.

ARTIFICIAL LIGHTING.

SANITARY COMPARTMENTS, BATHROOMS, SHOWER ROOMS, AIRLOCKS 7 LAUNDRIES MUST BE PROVIDED WITH ARTIFICIAL LIGHTING IF NATURAL LIGHT IN ACCORDANCE WITH RELEVANT PROVISIONS CAN NOT BE PROVIDED.

ARTIFICIAL LIGHTING MUST BE PROVIDED AT A RATE OF NOT LESS THAN ONE LIGHT FITTING PER 16m2 OF FLOOR AREA OR IN ACCORDANCE WITH AS/NZ 1680.

VENTILATION.

VENTILATION MUST BE PROVIDED TO ALL HABITABLE ROOMS AT A MINIMUM OF 5% OF THE FLOOR AREA OF THE ROOM REQUIRED TO BE VENTILATED, REFER TO PART 10.6 of NCC 2022.

VENTILATION CAN BE PROVIDED VIA AN OPENING, WINDOW, DOOR OR OTHER DEVICE WHICH CAN BE OPENED, WHICH MUST OPEN TO A SUITABLY SIZED COURT OR OPEN SPACE TO THE SKY, AN OPEN VERANDAH, CARPORT OR THE LIKE.

AN EXHAUST FAN OR OTHER MEANS OF MECHANICAL VENTILATION MAY BE USED TO VENTILATE A SANITARY COMPARTMENT, LAUNDRY OR BATHROOM, PROVIDED CONTAMINATED AIR EXHAUSTS DIRECTLY TO OUTSIDE OF BUILDING BY WAY OF DUCTS, OR INTO A ROOF SPACE THAT IS ADEQUATELY VENTILATED BY OPEN EAVES OR ROOF VENTS OR IS COVERED BY ROOF TILES WITHOUT SARKING.

SANITARY COMPARTMENTS MUST NOT OPEN DIRECTLY ONTO A KITCHEN OR PANTRY UNLESS VIA AN AIRLOCK, HALLWAY OR OTHER ROOM OR THE SANITARY COMPARTMENT IS PROVIDED WITH AN EXHAUST FAN OR OTHER MEANS OF MECHANICAL VENTILATION.


ENERGY EFFICIENCY.

IN A CLASS 1 BUILDING IT MUST ACHEIVE AN ENERGY RATING OF NOT LESS THAN 6 STARS. IF THE BUILDING HAS AN OUTDOOR LIVING AREA THAT COMPLIES WITH CLAUSE 13.1.1 IF THE OUTDOOR LIVING AREA IS FULLY COVERED WITH AN IMPERVIOUS ROOF OR HAS AT LEAST ONE PERMANENTLY INSTALLED CEILING FAN.

THESE PLANS HAVE BEEN PREPARED FOR THE EXCLUSIVE USE OF THE CUSTOMER AND FOR THE PURPOSE EXPRESSLY NOTIFIED TO THE AUTHOR. ANY OTHER PERSON WHO USES OR RELIES ON THESE PLANS WITHOUT THE AUTHORS WRITTEN CONSENT DOES SO AT OWN RISK AND NO RESPONSIBILITY IS ACCEPTED BY THE AUTHOR FOR SUCH USE AND/ OR RELIANCE.

THESE NOTES ARE NEITHER EXHAUSTIVE NOR A SUBSTITUTE FOR REGULATIONS, STATUTORY REQUIREMENTS, BUILDING PRACTICE OR CONTRACTUAL OBLIGATIONS AND UNLESS EXPRESSLY STATED OTHERWISE, ARE PROVIDED ONLY AS GUIDELINES. NO RESPONSIBILITY IS ACCEPTED FOR THEIR USE. THE BUILDER SHALL TAKE ALL STEPS NECESSARY TO ENSURE THE STABILITY OF NEW AND EXISTING STRUCTURES DURING ALL WORKS. THE BUILDER SHALL ENSURE FOR THE GENERAL WATER TIGHTNESS OF ALL NEW AND EXISTING WORKS.

REVISIONS:



Please note: Grade surface away from the Building to a minimum distance of 1.0 metres at a 1 in 20 minimum fall, and collect all stormwater runoff via a PVC channel or spoon drain and connect to SWD.
SURFACE DRAIN

GURU BUILDING GROUP

Address: UNIT 7
133-143 ELGAR ROAD, DERRIMUT
email: admin@gurubuildinggroup.com.au
Phone: 0405402789

PROJECT: PROPOSED RESIDENCE & GARAGE
ADDRESS: LOT 1539,11 FENWICK STREET,TARNEIT 3029


CLIENT: AVISTA HOMES

DRAWING STATUS: WORKING DRAWING	TITLE NOTES	ISSUE 1	DRAWN	DATE 19/04/24	SHEET SIZE A3
			CHECKED	SCALE 1:100	
			PAGE 2	DRW. NUMBER 20459	

BUSHFIRE NOTES

BAL LEVEL: 12.5

- EXPOSED EXTERNAL WALL CONSTRUCTION LESS THAN 400mm FROM GROUND OR LESS THAN 400mm ABOVE DECKS SHALL BE OF NON COMBUSTIBLE CONSTRUCTION.
- ALL JOINTS IN THE EXTERNAL SURFACE MATERIAL OF WALLS SHALL BE COVERED, SEALED, OVERLAPPED, BACKED OR BUTT-JOINTED TO PREVENT GAPS GREATER THAN 3mm
- VENTS AND WEEPHOLES IN EXTERNAL WALLS SHALL BE SCREENED WITH MESH WITH A MAXIMUM APERTURE OF 2mm, MADE OF CORROSION RESISTANT STEEL, BRONZE OR ALUMINIUM, EXCEPT WHERE THEY ARE LESS THAN 3mm OR ARE LOCATED IN AN EXTERNAL WALL OF A SUBFLOOR SPACE (VENTS, VENTILATION TO BE PROVIDED WITH EMBER GUARD)
- WHERE GLAZING IS LESS THEN 400mm FROM THE GROUND OR LESS THAN 400mm ABOVE DECKS, CARPORT ROOFS, AWNINGS AND SIMILAR ELEMENTS OR FITTINGS, HAVING AN ANGLE LESS THEN 18 DEGREES TO THE HORIZONTAL AND EXTENDING MORE THAN 110mm IN WIDTH FROM THE WINDOW FRAME, THE GLAZING SHALL BE GRADE 'A' SAFETY GLASS MINIMUM 4mm. OR GLASS BLOCKS WITH NO RESTRICTION ON GLAZING METHODS.
- OPENABLE WINDOW ASSEMBLIES SHALL BE COMPLETELY PROTECTED EXTERNALLY BY SCREENS WITH A MESH WITH A MAXIMUM APERTURE OF 2mm, MADE OF CORROSION-RESISTANT STEEL, BRONZE OR ALUMINIUM. (IF SELECTED)
- WEATHER STRIPS, DRAUGHT EXCLUDERS OR DRAUGHT SEALS SHALL BE INSTALLED AT THE BASE OF SIDE-HUNG EXTERNAL DOORS
- SIDE HUNG EXTERNAL DOORS & SLIDING DOORS SHALL BE COMPLETELY PROTECTED EXTERNALLY BY SCREENS WITH A MESH WITH A MAXIMUM APERTURE OF 2mm, MADE OF CORROSION-RESISTANT STEEL, BRONZE OR ALUMINIUM. (IF SELECTED).
- PANEL LIFT, TILT DOORS (BOTTOM 400mm NON COMBUSTIBLE) OR SIDE-HUNG DOORS SHALL BE FITTED WITH SUITABLE WEATHER STRIPS, DRAUGHT EXCLUDERS, DRAUGHT SEALS OR GUIDE TRACKS, AS APPROPRIATE TO THE DOOR TYPE, WITH MAXIMUM GAP NO GREATER THAN 3mm
- THE ROOF/WALL JUNCTION SHALL BE SEALED, TO PREVENT OPENINGS GREATER THAN 3mm, EITHER BY THE USE OF FASCIA AND EAVES LININGS OR BY SEALING BETWEEN THE TOP OF THE WALL AND THE UNDERSIDE OF THE ROOF AND BETWEEN THE RAFTERS AT THE LINE OF THE WALL.
- TILED ROOFS SHALL BE FULLY SARKED. THE SARKING SHALL BE LOCATED ON TOP OF THE ROOF FRAMING, EXCEPT THAT THE ROOF BATTENS MAY BE FIXED ABOVE THE SARKING; COVER THE ENTIRE ROOF AREA INCLUDING RIDGES & HIPS; AND EXTEND INTO GUTTERS & VALLEYS.
- EAVE PENETRATIONS SHALL BE PROTECTED THE SAME AS FOR ROOF PENETRATIONS, AS SPECIFIED IN CLAUSE 5.6.5. JOINTS IN EAVE LININGS, FASCIAS AND GABLES MAY BE SEALED WITH PLASTIC JOINING STRIPS OR TIMBER STORM MOULDS.
- ROOF PENETRATIONS, INCLUDING ROOF LIGHTS, ROOF VENTILATORS, ROOF-MOUNTED EVAPORATIVE COOLING UNITS, AERIALS, VENT PIPES AND SUPPORTS FOR SOLAR COLLECTORS SHALL BE ADEQUATELY SEALED AT THE ROOF TO PREVENT GAPS GREATER THAN 3mm. THE MATERIAL USED TO SEAL THE PENETRATION SHALL BE NON-COMBUSTIBLE.
- OPENINGS IN VENTED ROOF LIGHTS, ROOF VENTILATORS OR VENT PIPES SHALL BE FITTED WITH EMBER GUARDS MADE FROM A MESH OR PERFORATED SHEET WITH A MAXIMUM APERTURE OF 2mm, MADE OF CORROSION RESISTANT STEEL, BRONZE OR ALUMINIUM
- EVAPORATIVE COOLING UNITS SHALL BE FITTED WITH BUTTERFLY CLOSERS AT OR NEAR THE CEILING LEVEL, OR THE UNIT SHALL BE FITTED WITH NON-COMBUSTIBLE COVERS WITH A MESH OR PERFORATED SHEET WITH A MAXIMUM APERTURE OF 2mm, MADE OF CORROSION RESISTANT STEEL, BRONZE OR ALUMINIUM. (IF SELECTED)
- ABOVE-GROUND, EXPOSED WATER AND GAS SUPPLY PIPES SHALL BE METAL



Please note: Grade surface away from the Building to a minimum distance of 1.0 metres at a 1 in 20 minimum fall, and collect all stormwater runoff via a PVC channel or spoon drain and connect to SWD.
SURFACE DRAIN

ENERGY NOTES

The following items are a summary of the minimum requirements in order to achieve the above star rating. Please read these items in conjunction with the attached report and stamped endorsed plans.

CEILING:

Minimum Insulation Value's:

- R4.0 bulk insulation to all ceiling areas open to roof space. (Excluding above garage).

EXTERNAL AND INTERNAL WALL SPECIFICATIONS :

- R2.0 bulk insulation with 1 layer of non-reflective foil sarking to all external walls excluding garage.
- R2.0 bulk insulation to all internal garage walls only.

WINDOWS :

- All windows and sliding doors to aluminium framed single glazed.

TYPE	U-VALUE	SHGC	AREA (SQM)
ALM-001-01 A Aluminium A SG Clear	6.70	0.57	5.04
ALM-002-01 A Aluminium B SG Clear	6.70	0.70	23.19


NOTE: There is only a 5% tolerance to the nominated SHGC window values on this energy report.

Additional Provisions as per Part 13:

- Insulation is to be installed in accordance with the provisions.
- All construction elements are to be sealed in accordance with the provisions outlined in application of Part 13.4
- A hot water supply system must be designed and installed . Installation to be in accordance application of Part 13.7
- Central heating water piping and heating/cooling ductwork must use thermal insulation material. Installation to be in accordance WITH NCC 13.7.1.
- All residential lighting is subject to meeting performance levels outlined in artificial lighting.

Assessment Notes:

- Construction drawings are assessed based on the requirements outlined in the National Construction Code Part 13.1 and NATHERS Technical Note 2.
- Any alteration to the construction drawings or alterations during/post construction will render this energy efficiency assessment void.
- All results are based on a fixed assumption that a minimum of holland blinds will be installed by the owner upon Certificate of Occupancy being issued. All other window furnishings cannot be simulated.
- Typical solar absorbance values are located within .
- Rainwater tanks or solar hot water units do not form part of a 6-star energy report. Please consult NCC V2.6.1a or your registered building surveyor for further information.
- Default Clause 10.12 from NATHERS Technical Note 2 will be adopted if no neighboring building information is documented on the assessed drawings.



DRAINAGE GUIDE SHOWN IS FOR ROOF DRAINAGE ONLY, ALL SITE DRAINAGE AS PER PLUMBER AND BUILDERS DESIGN, BUILDING SURVEYOR TO CONFIRM.

CONCRETER / BUILDER TO MAKE SURE THAT A MIN.385MM TO BE EXCAVATED BELOW FLOOR LEVEL IN RESIDENCE AND GARAGE FOR A WAFFLE SLAB. CHECK ON SITE BEFORE COMMENCING.

DWELLINGS MUST HAVE AS A MINIMUM A RECYCLED WATER TAP TO THE LAUNDRY WHICH A WASHING MACHINE CAN CONNECT TO

LANDSCAPING LAYOUT PLANS , AND SPECIES TO BE AS PER DEVELOPERS DETAILS

THE BUILDER MUST COMPLETE ALL FIBRE CABLE ENTRY WORK IN ACCORDANCE WITH OPTICOMM GUIDELINES

DWELLING MUST INCORPORATE DUAL PLUMBING FOR THE USE OF RECYCLED WATER IN TOILET FLUSHING AND GARDEN WATERING


TELEVISION ANTENNAS MUST BE LOCATED WITHIN THE HOUSE ROOF

NO RETAINING WALLS TO THE FRONT OF THE HOUSE

Garages accessed from the front of a lot must be set back 5m from the front boundary of the lot.

The driveway must be set back a minimum of 0.5m from the side boundary to provide a strip for landscaping.
 Driveways must be constructed from:
 Exposed aggregate concrete, Coloured-through concrete, Natural Stone.
 Any other VHDAP approved finish. Driveway colours should be muted.
 Plain (uncoloured) concrete and painted concrete (colour-on) driveways are not permitted.
 The driveway must be constructed prior to the occupancy of the dwelling.


Letterboxes should complement the dwelling in terms of materials, colour and style. Single post supported letterboxes are not permitted.

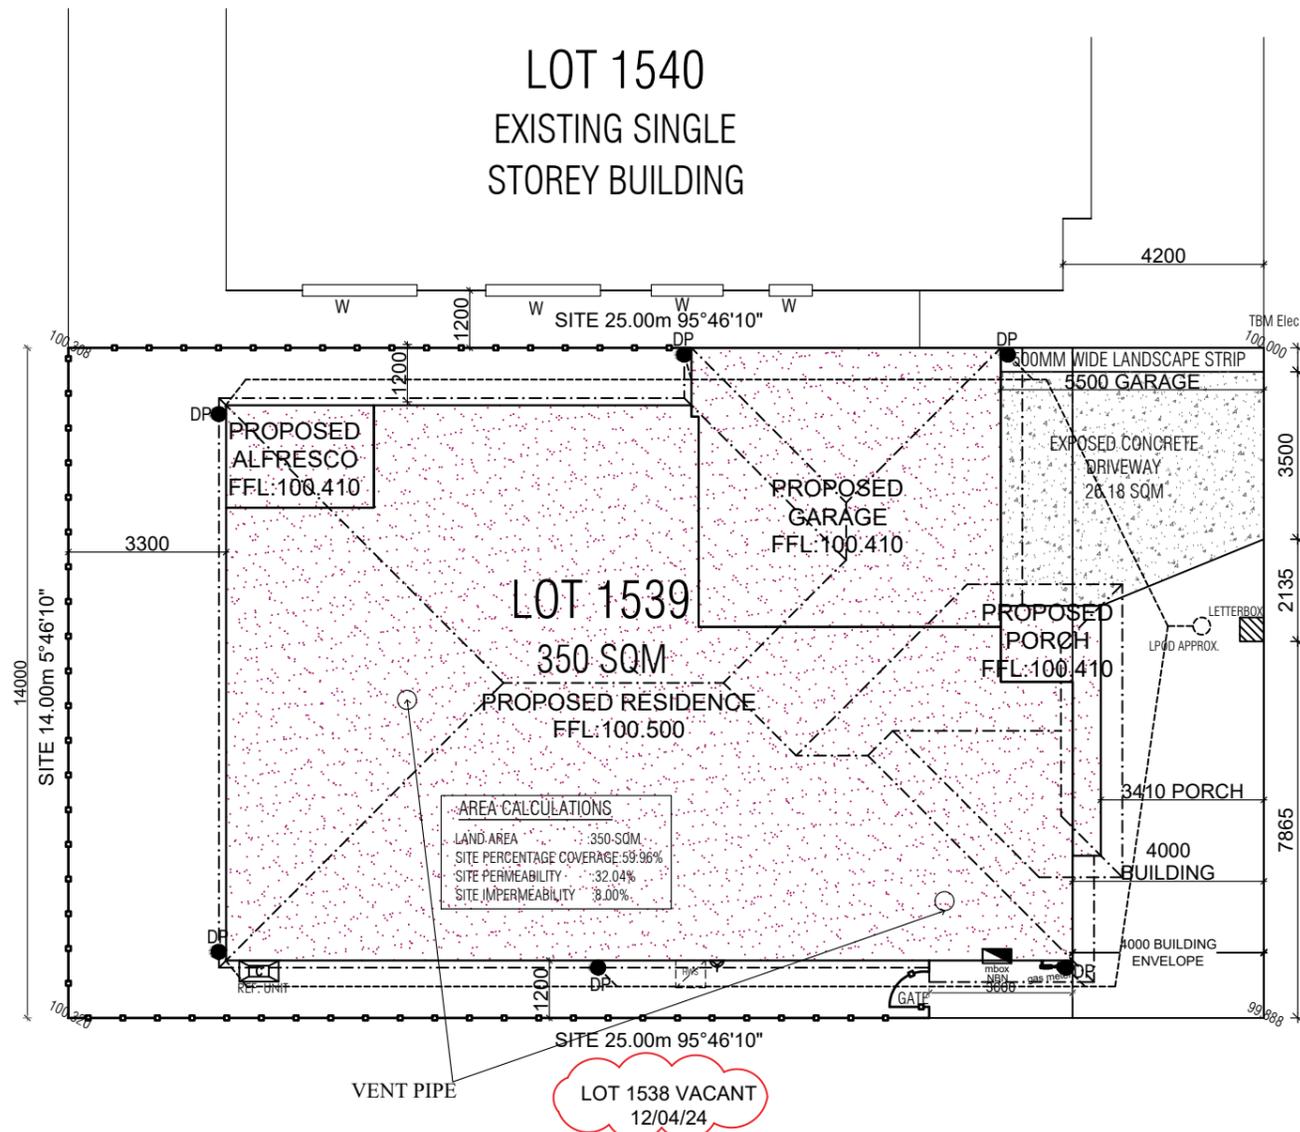

Fencing between lots must be:
 Constructed with timber posts and lapped palings.
 A maximum height of 1.8m above natural ground level up to 1.95m including base.
 Terminated a minimum of 1m behind the closest front wall of the dwelling, unless it is on the rear boundary of an adjoining lot.
 Terminated by returning to meet the closest wall of the dwelling return fence.
 Colorbond Fencing is not permitted.

"Any Outbuildings, External Light fittings, Service Equipment, and other ancillary items must meet the requirements of Section 4.6 of the Verdant Hill Design Guidelines."

BAL LEVEL: 12.5

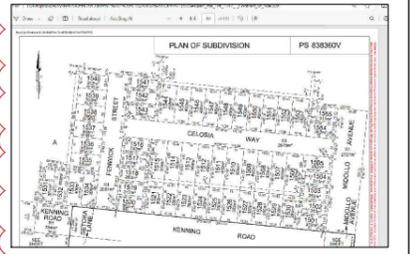

APPROX.31.50M TO THE NEAREST CELOSIA WAY

ALL LEVELS AND FINISHED FLOOR LEVELS ARE TAKEN FROM ENGINEERING PLAN PROVIDED BY THE COUNCIL
 STORMWATER INFORMATION CERTIFICATE , BUILDER IS TO VERIFY ON SITE ALL LEVELS PRIOR TO THE COMMENCEMENT OF ANY BUILDING WORKS. NEW LEVELS SHOULD BE DONE TO DETERMINE NEW SITE CONDITIONS.

STORMWATER POINT TO BE VERIFIED ON SITE PRIOR TO THE COMMENCEMENT OF ANY BUILDING WORKS. STORMWATER LAYOUT AS PER PLUMBERS AND BUILDERS DESIGN AND TO BE CONFIRMED ON SITE BY THE PLUMBER AND BUILDER.

ALL SURROUNDING SURFACES ARE TO BE GRADED AWAY FROM THE BUILDING TOWARDS A SUITABLE DRAINAGE FACILITY, TO AVOID ANY LOCAL DAMMING OR PONDING. BUILDING SURVEYOR IS TO CHECK AND VERIFY THAT NO SERVICES ARE PLACED WITHIN 45° ANGLE OF REPOSE TO PROPERTY FOOTINGS. NEW FOOTINGS ARE NOT TO UNDERMINE EXISTING FOOTINGS AND ARE TO MATCH THE DEPTH OF THE EXISTING FOOTINGS , WHERE APPROPRIATE.

INSTALL SURFACE SPOON DRAINS AND CUT-OFF DRAINS UPSLOPE OF THE BUILDING SITE TO INTERCEPT AND CHANNEL BOTH RUN-OFF AND SHALLOW GROUNDWATER SEEPAGE AWAY FORM THE SITE CUTS AND FOUNDATIONS. CUT OFF DRAINS SHOULD PENETRATE 50MM BELOW THE UPPER CLAY SURFACE. BUILDER TO BE VERIFY ON SITE PRIOR TO THE COMMENCEMENT OF ANY BUILDING WORKS.

NOTES:
 RW: DENOTES RAIN WATER HEAD.
 D: DENOTES DOWN PIPES.
 S : WITH SPREADER PIPE LOCATED ON ROOF ONLY.

ALL CUT AND FILLS SHOULD BE BATTERED OR RETAINED PROPERLY. AS A GENERAL RULE, BATTERS OF 45 DEGREES TO THE HORIZONTAL FOR CLAYS AND 30 DEGREES TO THE HORIZONTAL FOR SANDS SHOULD BE ADOPTED. WHERE THIS IS NOT POSSIBLE OR DESIRED, ENGINEER DESIGNED RETAINING WALLS SHOULD BE USED. WHERE SITES ARE PRONE TO LANDSLIPS , A LANDSLIP ASSESSMENT SHOULD BE CARRIED OUT.



Adjoining properties:	
Crossover location :	Left hand side
Building envelope on property:	
Bushfire construction Property:	
Termite construction Property:	
ESTATE:	


NOTE: WHILE ALL CARE IS TAKEN IN THE SITING OF THIS HOME, IT MAY VARY DUE TO ESTATE COVENANT, LOCAL COUNCIL , STATE GOVERNMENT , VICTORIAN DEVELOPMENT CODE, ENERGY EFFICIENCY REQUIREMENTS, SITE AND SOIL CONDITIONS AND THE APPROVAL OF ANY BOUNDARY RELAXATIONS REQUIRED.

NOTE: NATURAL GAS IS AVAILABLE ON SITE. PROVIDE GAS METER LOCATING GAS MAIN CONNECTION FROM GAS MAIN TO HOUSE .

DIAL BEFORE YOU DIG
 Australia's National Referral Service for Information on Underground Pipes & Cables



REVISIONS:



GURU BUILDING GROUP
 Address: UNIT 7
 133-143 ELGAR ROAD, DERRIMUT
 email: admin@gurubuildinggroup.com.au
 Phone: 0405402789

PROJECT:	PROPOSED RESIDENCE & GARAGE	CLIENT:	AVISTA HOMES
ADDRESS:	LOT 1539,11 FENWICK STREET,TARNEIT 3029		
DRAWING STATUS:	WORKING DRAWING	TITLE:	SITE
ISSUE:	1	DATE:	19/04/24
		SCALE:	1:100
		CHECKED:	PAGE 5
		DRW. NUMBER:	20459
		SHEET SIZE:	A3



NOTES:
 RWH : DENOTES RAIN WATER HEAD. S : KITCHEN SINK.
 DP : DENOTES DOWNPIPES. HB : HAND BASIN.
 DPS : WITH SPREADER PIPE. VB : VANITY BASIN.
 LOCATED UBO : UNDER BENCH OPEN.
 ON ROOF ONLY. DW : DISHWASHER.
 SD : DENOTES SMOKE DETECTORS. TR : LAUNDRY TROUGH.
 EF : EXHAUST FANS.

BAL LEVEL: 12.5

SITE MEASUREMENTS WILL DICTATE FINAL SITE LEVELS AND FREEBOARD HEIGHTS.

WEEP HOLES AT 1.2 METRE SPACING AND ABOVE WINDOWS MORE THAN 1.0 METRE WIDE.

ALL PLYABLE MEMBRANE MUST COMPLY WITH AS42001.1 AND BE INSTALLED AS PER PART 10.8 NCC 2022 FOR CONDENSATION MANAGEMENT.

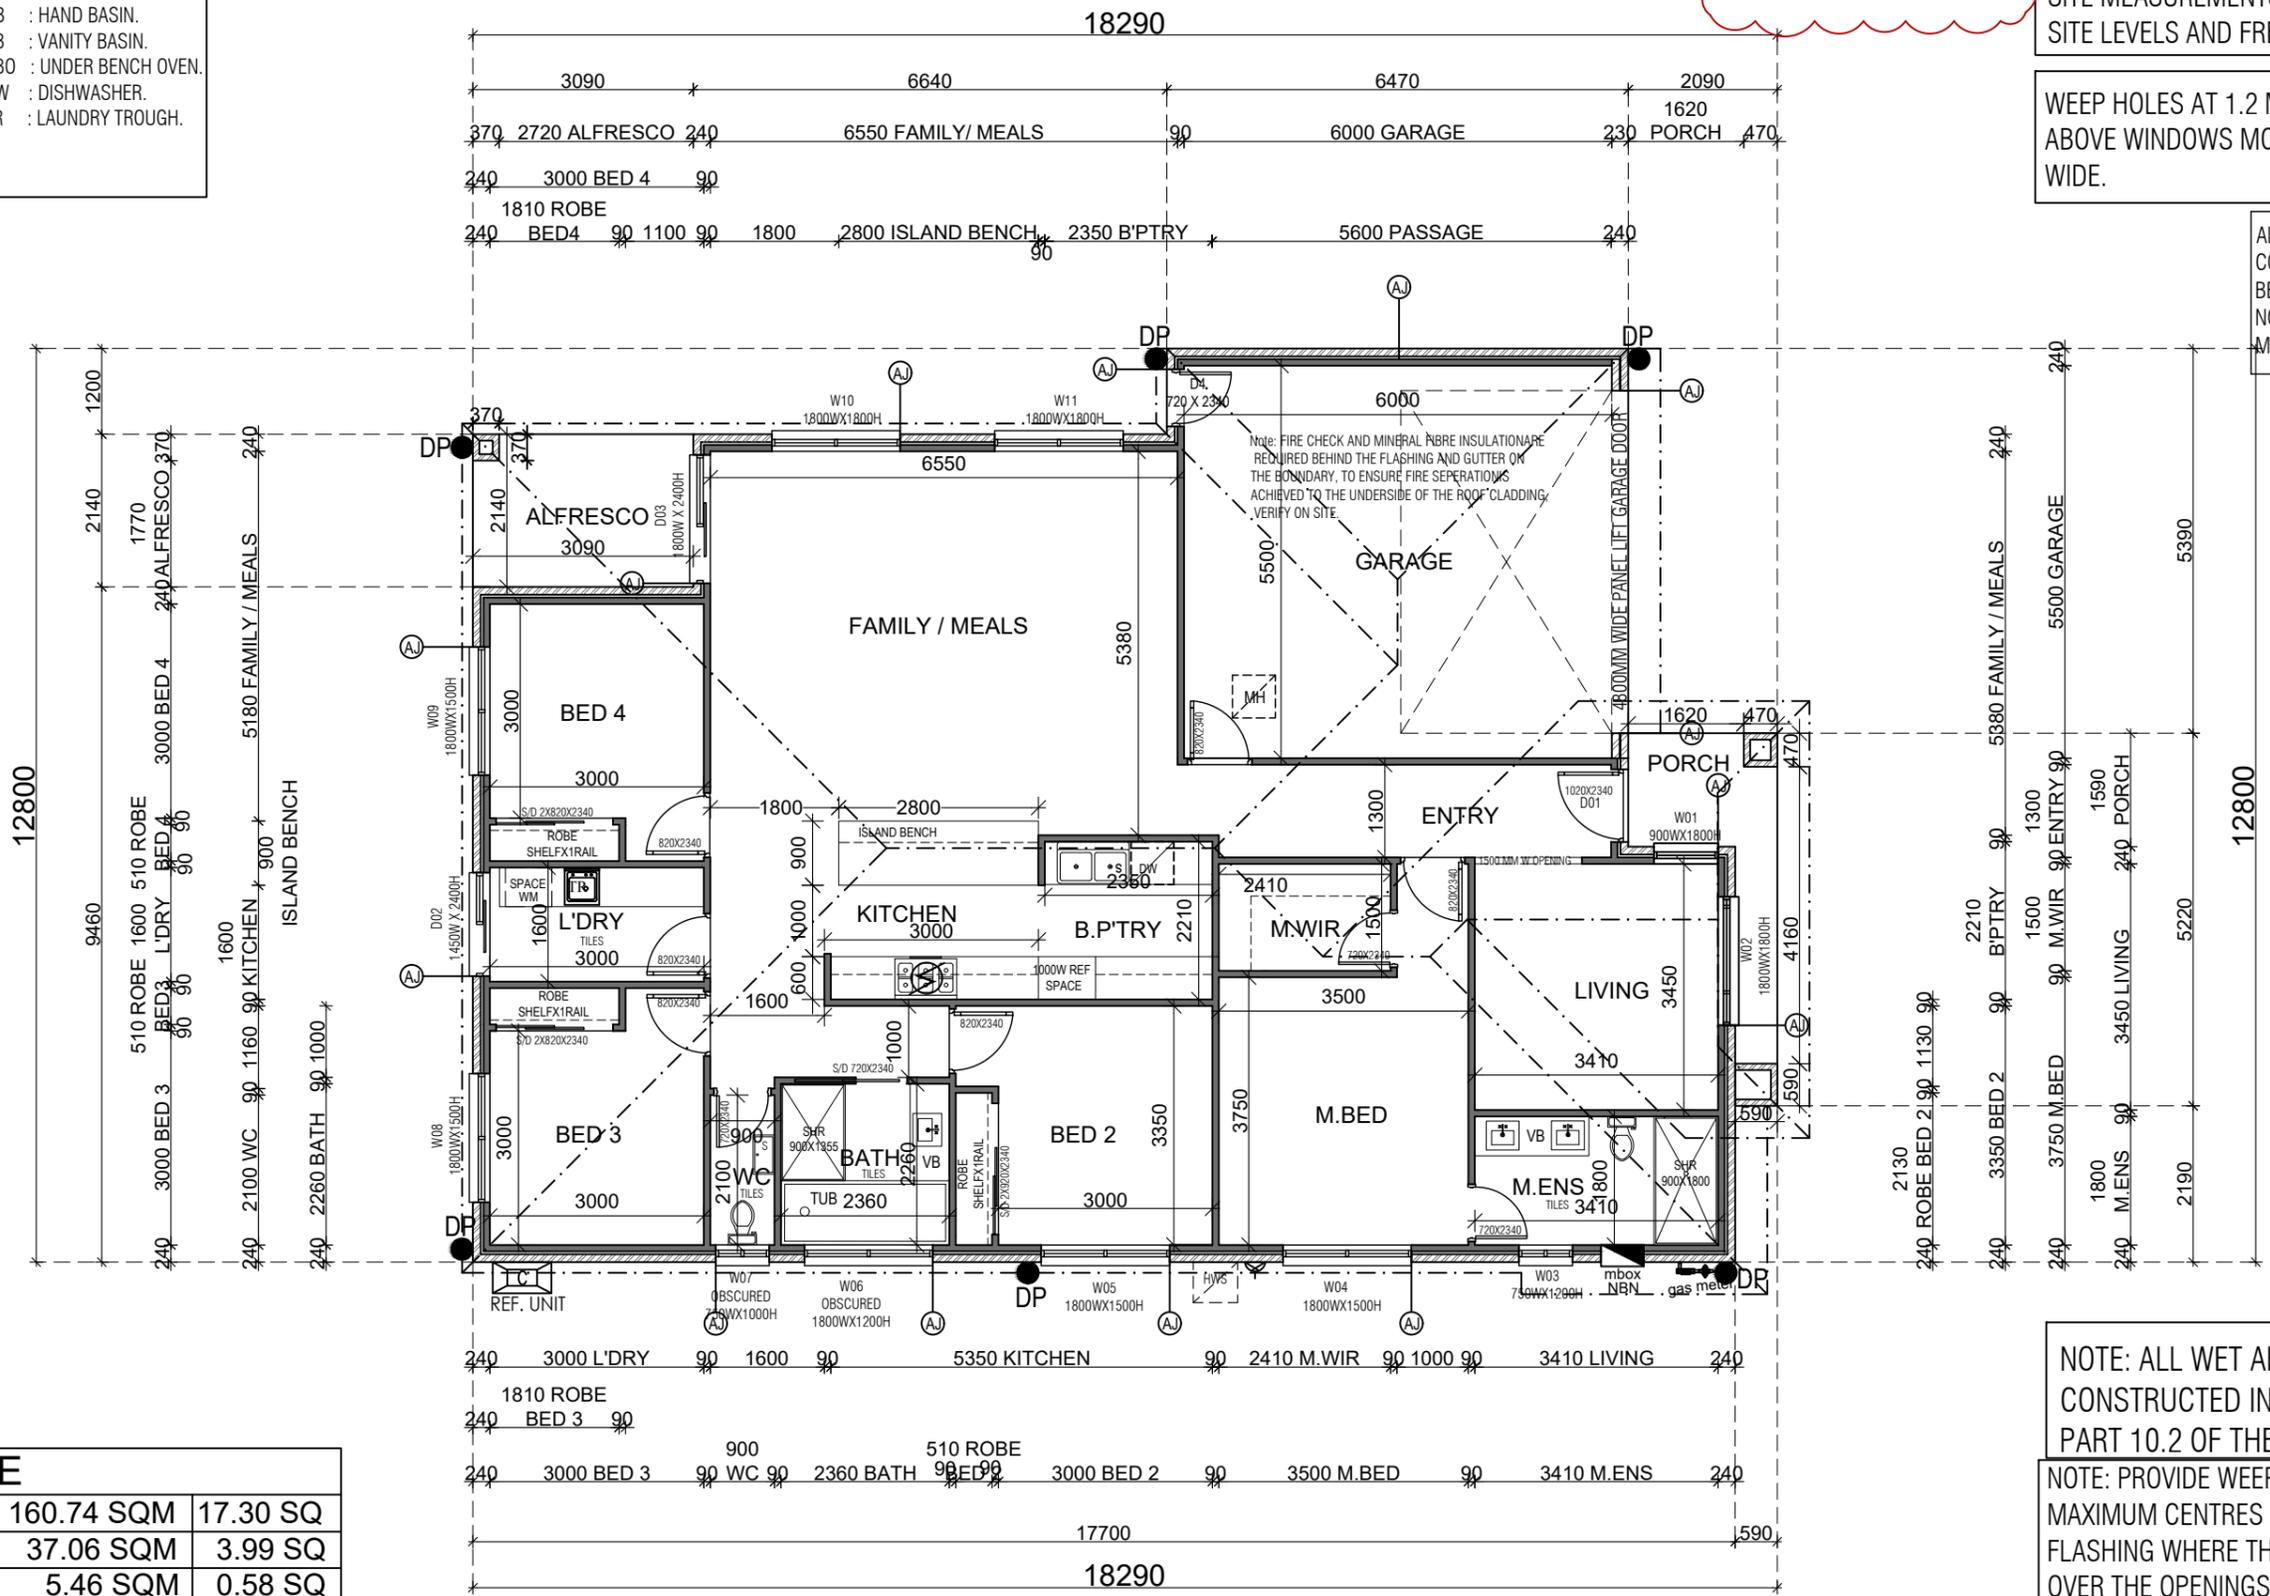

AREA SCHEDULE		
RESIDENCE	160.74 SQM	17.30 SQ
GARAGE	37.06 SQM	3.99 SQ
PORCH	5.46 SQM	0.58 SQ
ALFRESCO	6.61 SQM	0.71SQ
TOTAL	209.87 SQM	22.59 SQ

FLOOR PLAN 1:100

NOTE: ALL WET AREAS MUST BE CONSTRUCTED IN ACCORDANCE WITH PART 10.2 OF THE NCC 2022.

NOTE: PROVIDE WEEPHOLES AT 960MM MAXIMUM CENTRES WITH CONTINUOUS FLASHING WHERE THE BRICKWORK EXTENDS OVER THE OPENINGS

MECHANICAL VENTILATION TO BE DUCTED TO THE OUTER AIR.




REVISIONS:


Address: UNIT 7
 133-143 ELGAR ROAD, DERRIMUT
 email: admin@gurubuildinggroup.com.au
 Phone: 0405402789

GURU BUILDING GROUP

PROJECT: PROPOSED RESIDENCE & GARAGE		CLIENT: AVISTA HOMES	
ADDRESS: LOT 1539,11 FENWICK STREET,TARNEIT 3029			
DRAWING STATUS: WORKING DRAWING	TITLE: FLOOR PLAN	ISSUE: 1	DATE: 19/04/24
		CHECKED: 6	SHEET SIZE: A3
			SCALE: 1:100
			DRW. NUMBER: 20459

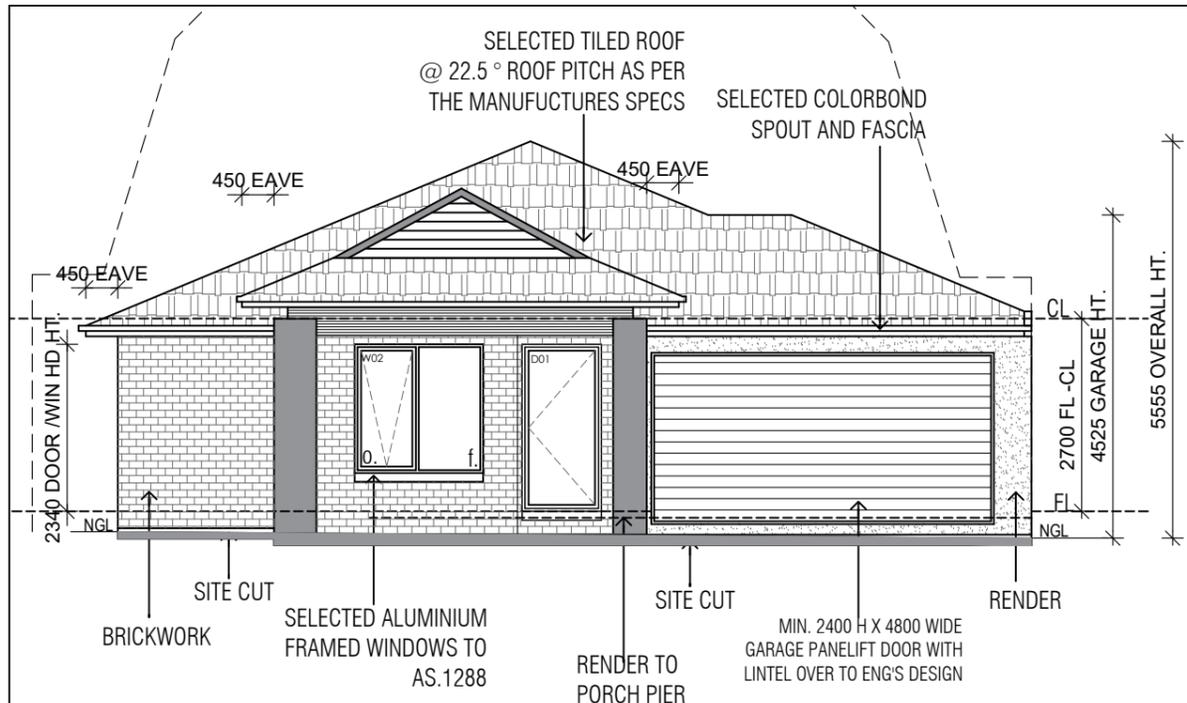


FRONT ELEVATION 1:100


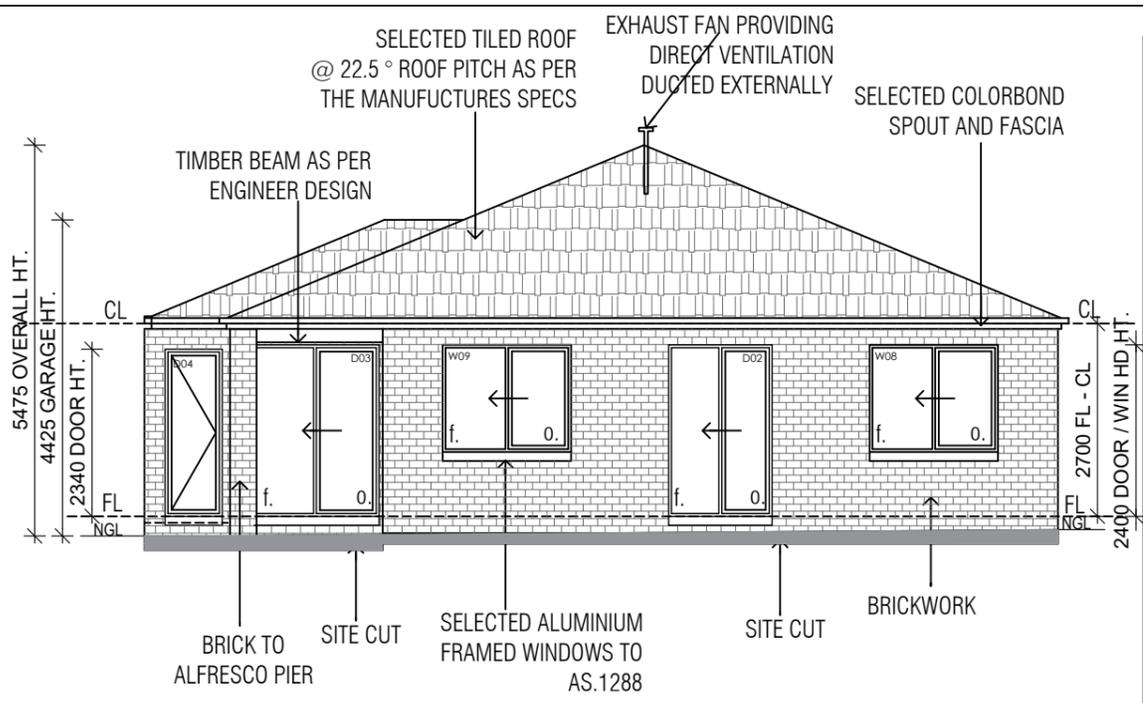


REAR ELEVATION 1:100

BAL LEVEL: 12.5

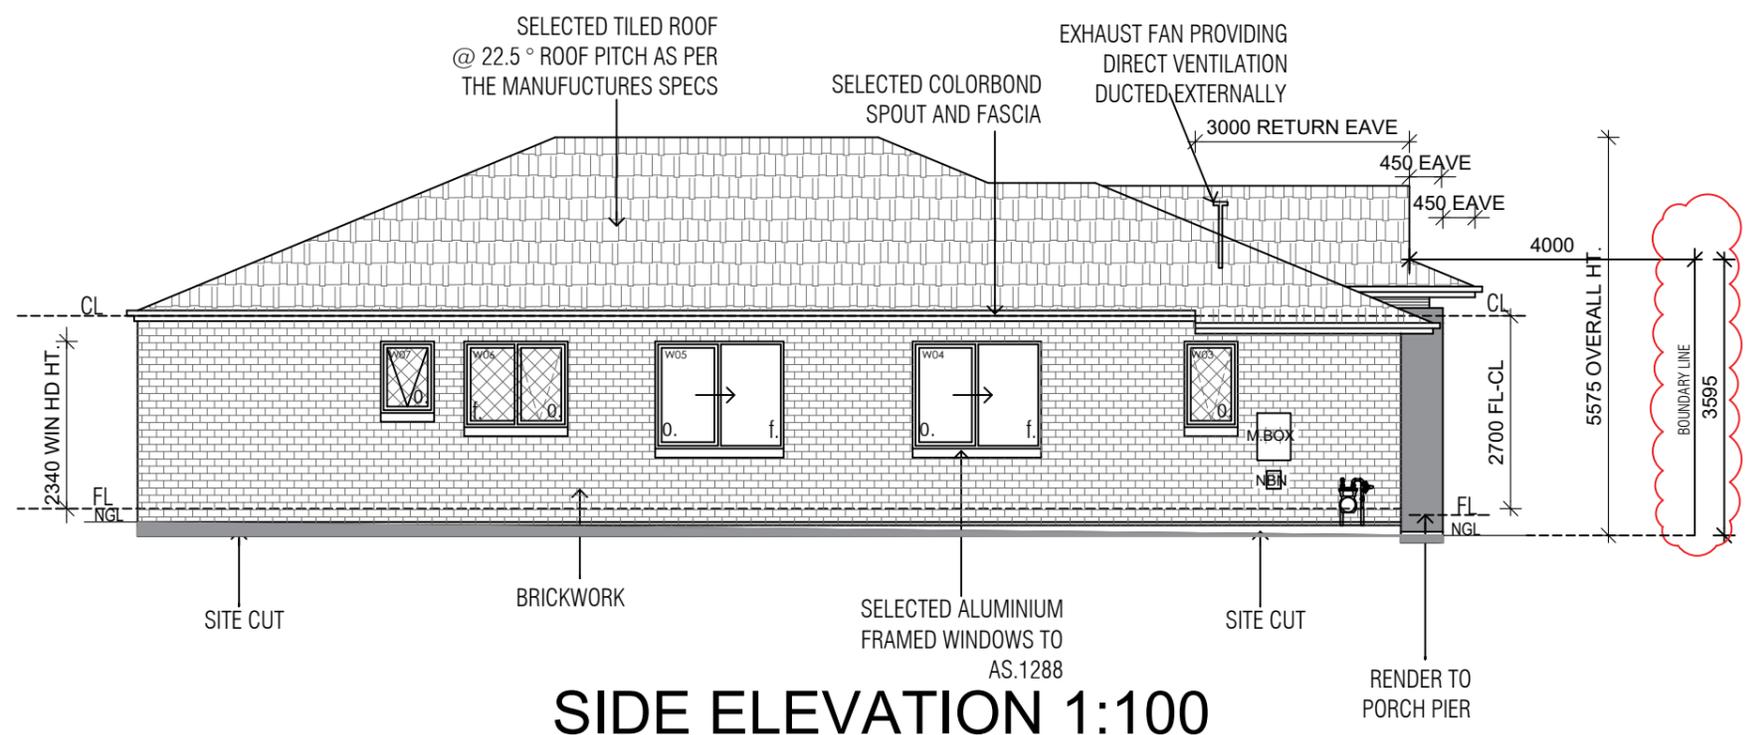

SIDE ELEVATION 1:100

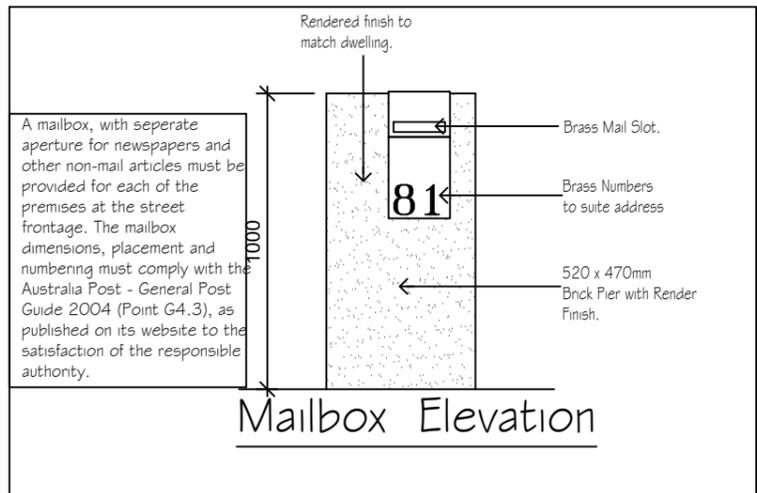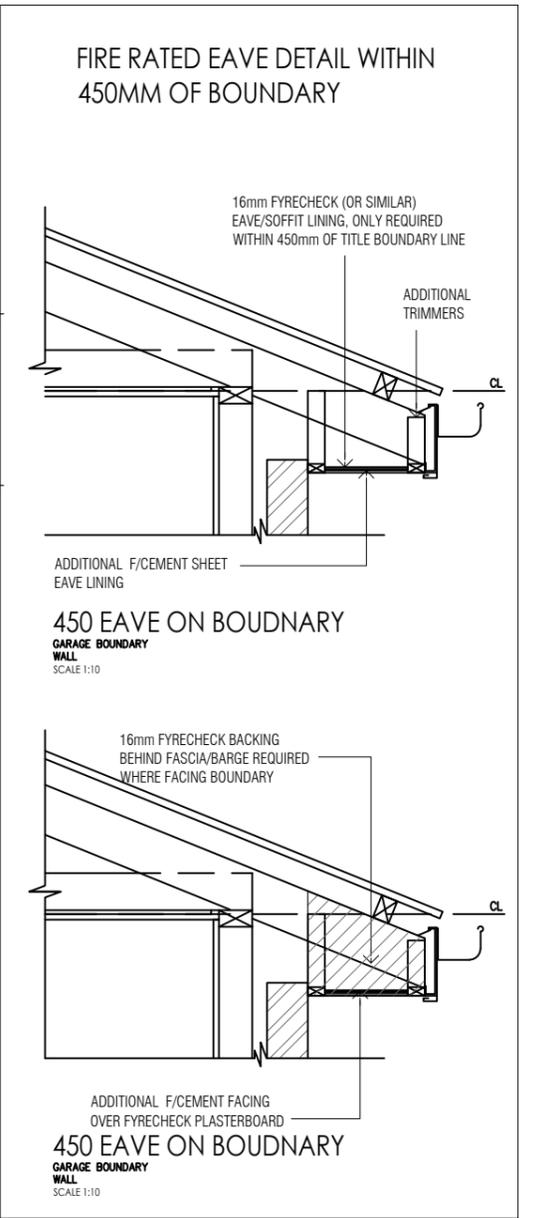

NOTE: PROVIDE WEEPHOLES AT 960MM MAXIMUM CENTRES WITH CONTINUOUS FLASHING WHERE THE BRICKWORK EXTENDS OVER THE OPENINGS


WEEPHOLES
WEEP HOLES AT 1.2 METRE SPACING AND ABOVE WINDOWS MORE THAN 1.0 METRE WIDE.

CJ : DENOTES CONTROL JOINT TO FULL HEIGHT OF BRICKWORK @6M MAX. CENTRES. ALL JOINTS TO CONFORM TO NOTE CN9 OF THE BRICKWORK AND CONCRETE ASSOCIATION. INFORMATION CONTAINED IN THE SOIL REPORT REGARDING CONTROL JOINTS TAKES PRECEDENCE.

LOW EMISSION PAINTS AND SEALANTS WILL BE USED ON >95% OF INTERNAL AND EXTERNAL PAINTED SURFACES




REVISIONS:



GURU BUILDING GROUP
Address: UNIT 7
133-143 ELGAR ROAD, DERRIMUT
email: admin@gurubuildinggroup.com.au
Phone: 0405402789

PROJECT: PROPOSED RESIDENCE & GARAGE
ADDRESS: LOT 1539,11 FENWICK STREET,TARNEIT 3029
DRAWING STATUS: WORKING DRAWING
TITLE: ELEVATION 1
ISSUE: 1

CLIENT: AVISTA HOMES
DATE: 19/04/24
SCALE: 1:100
PAGE: 7
DRW. NUMBER: 20459
SHEET SIZE: A3

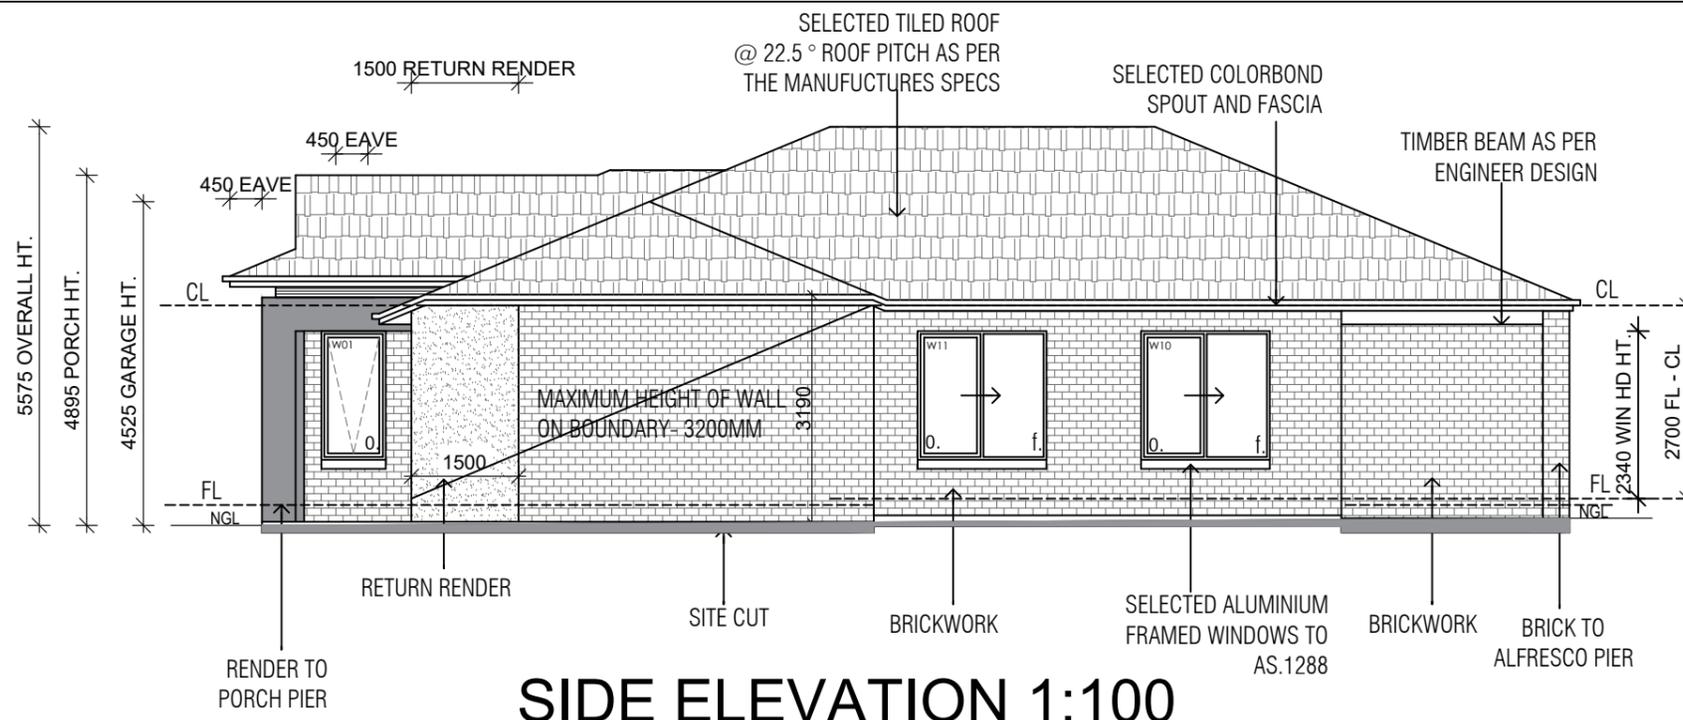

SIDE ELEVATION 1:100

GENERAL PARAMETERS

BOX HEIGHT	- 300MM
SLAB THICKNESS	- 100MM
INTERNAL RIB WIDTH	- 110MM
EXTERNAL RIB WIDTH	- 300MM
STEM WIDTH	- 150MM
OVERALL DEPTH	- 400MM
RIB SPACING	- 1200MAX.CTS


REINFORCEMENT

SLAB MESH	- SL92
INTERNAL RIB	- 1-N16 BAR BOTTOM
EXTERNAL RIB	- 2 LAYERS OF 3-LIITM BOTTOM OR 3-N16 1 N16 TOP BARS

BAL LEVEL: 12.5

COLOUR SELECTION

- ROOF - ALICE ROOF TILES - SLATE
- FASCIA,GUTTER WINDOW AND DOWNPIPES - COLORBOND MONUMENT
- RENDER TO THE -HOUSE - DULUX SILVER THAW
- RENDER TO PILLARS - COLORBOND MONUMENT
- BRICKS TO THE - AUSTRAL ACCESS CHESTNUT
- GARAGE DOOR - GLIDEROL SECTIONAL MADISON DULUX TERRACE WHITE
- FRONT DOOR/FEAME - HUME DOOR RICH WALNUT TIMBER STAIN
- TIMBER CLADDING - JAMES HARDIE PRIMELINE CHAMFER WEATHERBOARD DULUX TERRACE WHITE
- LETTERBOX - COLOUR (MATCH TO THE HOUSE)
- METERBOX - MONUMENT (MATCH TO THE HOUSE)
- DRIVEWAY - EXPOSED CONCRETE BORAL SUNDOWN

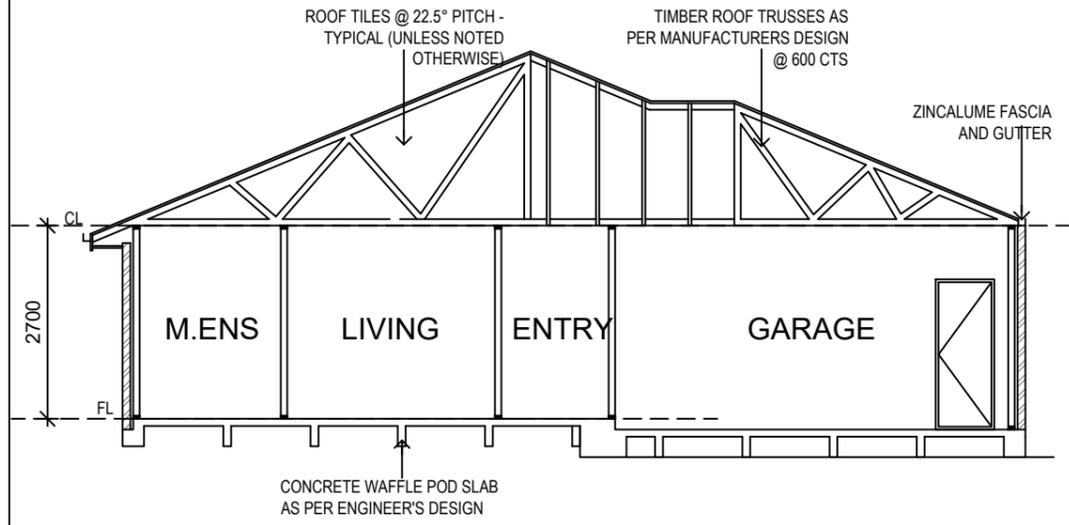

SECTION 1:100

DOOR AND WINDOW SCHEDULE

W1	900W X 1800H	CLEAR AWNING WINDOW	- ALUMINIUM STD
W2	1800W X 1800H	CLEAR AWNING WINDOW	- ALUMINIUM STD
W3	0750W X 1200H	OBSCURED AWNING WINDOW	- ALUMINIUM STD
W4	1800W X 1500H	CLEAR SLIDING WINDOW	- ALUMINIUM STD
W5	1800W X 1500H	CLEAR SLIDING WINDOW	- ALUMINIUM STD
W6	1500W X 1200H	OBSCURED AWNING WINDOW	- ALUMINIUM STD
W7	0750W X 1000H	OBSCURED AWNING WINDOW	- ALUMINIUM STD
W8	1800W X 1500H	CLEAR SLIDING WINDOW	- ALUMINIUM STD
W9	1800W X 1500H	CLEAR SLIDING WINDOW	- ALUMINIUM STD
W10	1800W X 1800H	CLEAR SLIDING WINDOW	- ALUMINIUM STD
W11	1800W X 1800H	CLEAR SLIDING WINDOW	- ALUMINIUM STD

DOOR SCHEDULE


D1	1020W X 2340H	TIMBER SINGLE ENTRY DOOR
D2	1450W X 2400H	ALUMINIUM IMPROVED SLIDING DOOR
D3	1800W X 2400H	ALUMINIUM IMPROVED SLIDING DOOR
D4	0720W X 2340H	TIMBER SINGLE GARAGE DOOR

NOTE: PROVIDE WEEPHOLES AT 960MM MAXIMUM CENTRES WITH CONTINUOUS FLASHING WHERE THE BRICKWORK EXTENDS OVER THE OPENINGS

CJ : DENOTES CONTROL JOINT TO FULL HEIGHT OF BRICKWORK @6M MAX. CENTRES. ALL JOINTS TO CONFORM TO NOTE CN9 OF THE BRICKWORK AND CONCRETE ASSOCIATION. INFORMATION CONTAINED IN THE SOIL REPORT REGARDING CONTROL JOINTS TAKES PRECEDENCE.




REVISIONS:




GURU BUILDING GROUP
 Address: UNIT 7
 133-143 ELGAR ROAD, DERRIMUT
 email: admin@gurubuildinggroup.com.au
 Phone: 0405402789

PROJECT: PROPOSED RESIDENCE & GARAGE
 ADDRESS: LOT 1539,11 FENWICK STREET,TARNEIT 3029
 DRAWING STATUS: WORKING DRAWING
 TITLE: ELEVATION 1
 ISSUE: 1


CLIENT: AVISTA HOMES
 DRAWN: DATE 19/04/24
 SCALE: 1:100
 CHECKED: PAGE 8
 DRW. NUMBER: 20459
 SHEET SIZE: A3

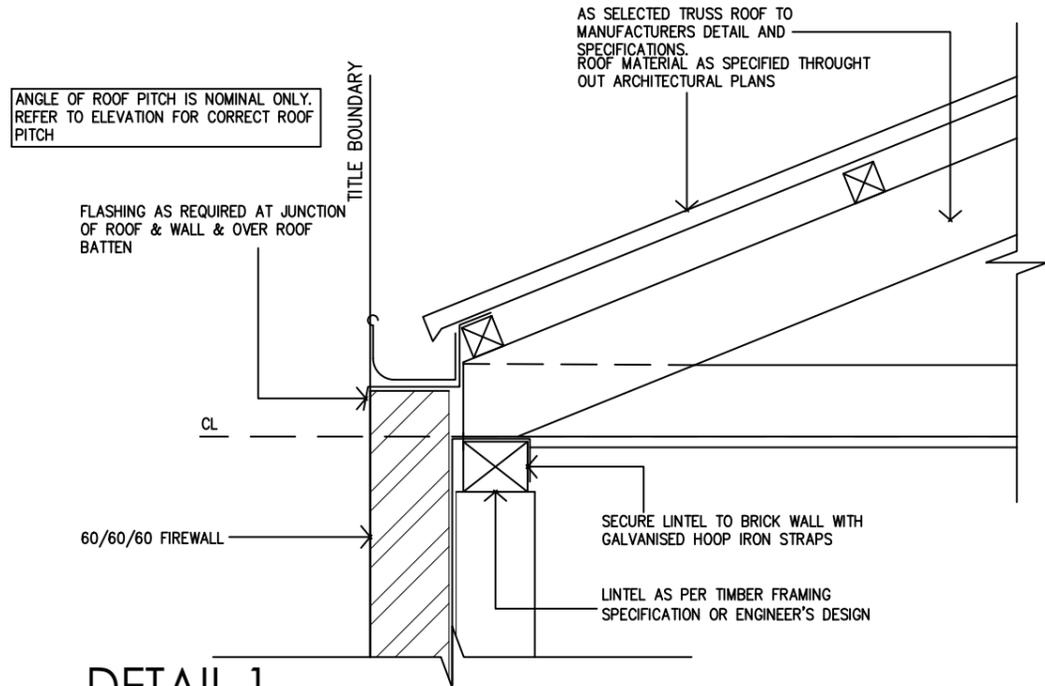


DETAIL 1
WALL ON BOUNDARY
NOT TO SCALE
SECTION DETAIL

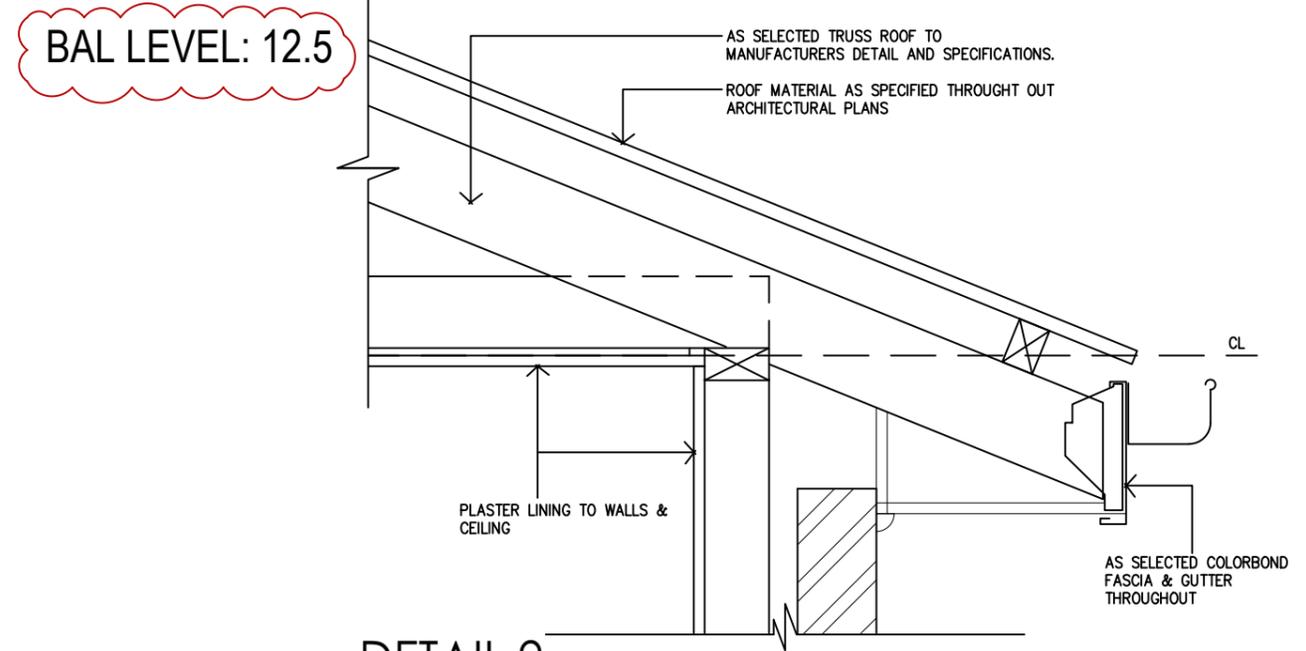

DETAIL 2
450mm EAVE DETAIL
NOT TO SCALE
SECTION DETAIL

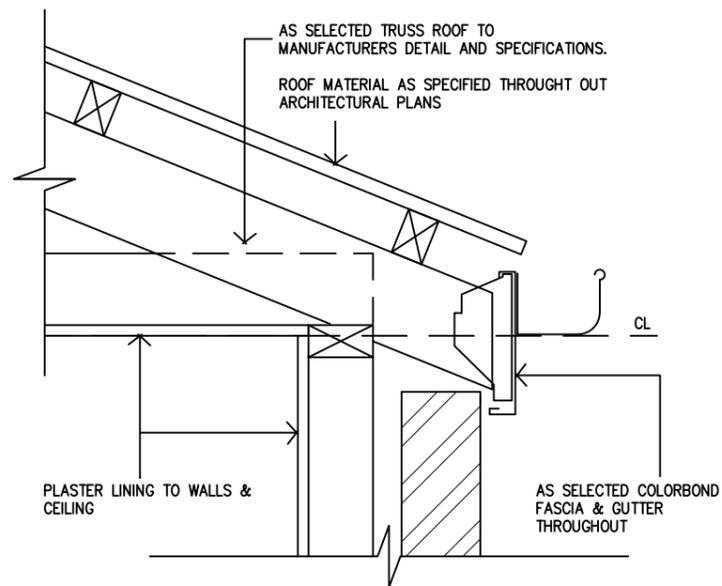


DETAIL 3
EAVE DETAIL
NOT TO SCALE
SECTION DETAIL

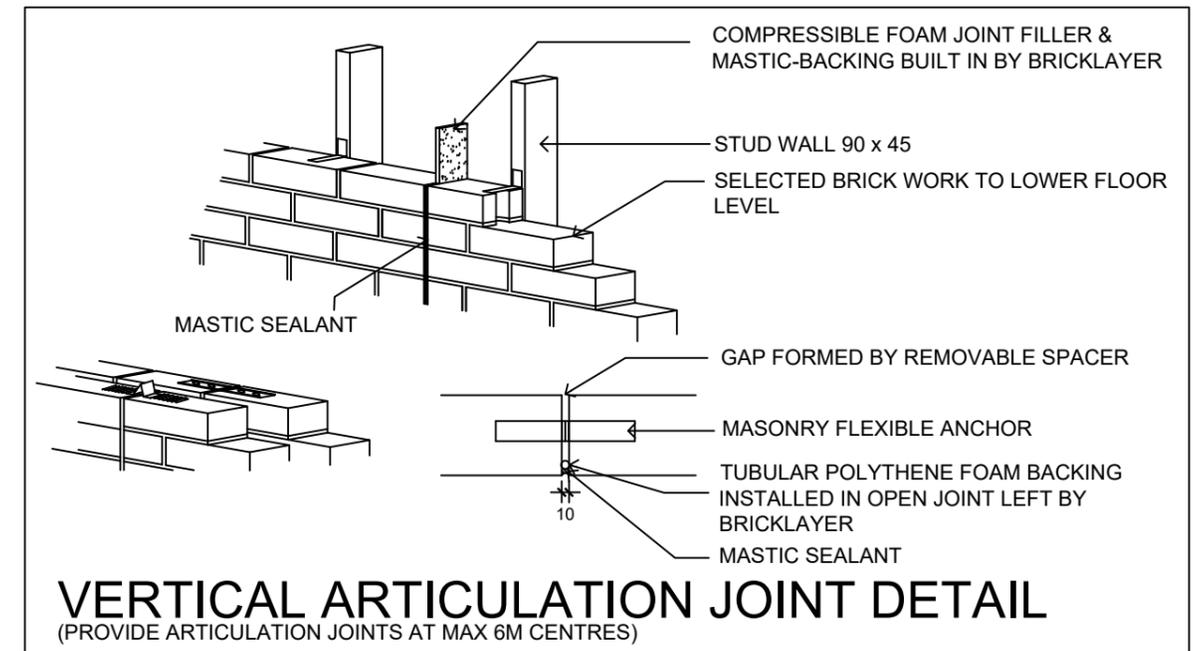

VERTICAL ARTICULATION JOINT DETAIL
(PROVIDE ARTICULATION JOINTS AT MAX 6M CENTRES)

BAL LEVEL: 12.5

FENWICK STREET

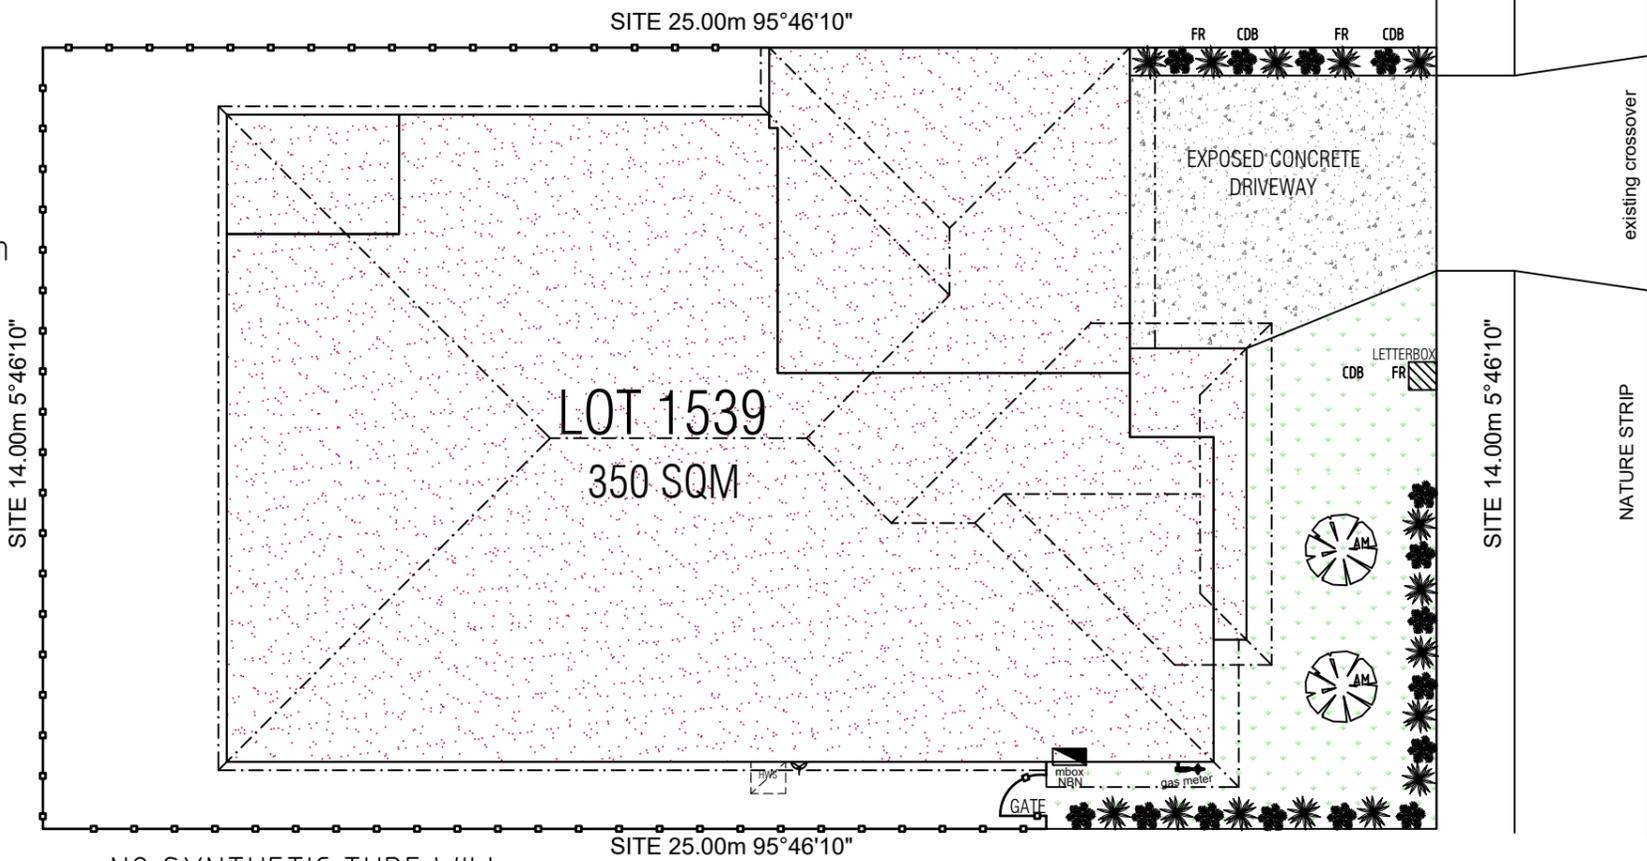

NO SYNTHETIC TURF WILL BE USED
 Note - Native Drought Tolerant Species plants must be used to maximise the use of these plants

- s, minimum further plantings required in your front yard are:
 - » A minimum of 5 medium to large shrubs (from 200mm pot size at installation); and
 - » A minimum of 8 smaller shrubs or ground cover plants (from 150mm pot size at installation).

Grass lawn must be installed on a minimum 100mm depth of topsoil.
 Avoid the use of prohibited weed species
 Trees installed must have a minimum mature height of 2.0m

Note - Site will be cleared for and all existing shrubs and low trees will be removed for new plants and trees

FRONT PATHS, PORCHES AND SIDE ACCESS PATHS ARE TO BE CONSTRUCTED FROM ONE OR A COMBINATION OF THE FOLLOWING TYPES OF MATERIAL: NATURAL STONE PAVING, EXPOSED AGGREGATE CAST-ON SITU CONCRETE PAVING, PRE-CAST PAVERS, NATURAL CRUSHED STONE AGGREGATE OR SELF BINDING GRAVEL (GREY OR BROWN IN COLOUR), OR NATURAL DECORATIVE PEDDLES IN NATURAL COLOURS OF GREY TO BROWN

GARDEN BEDS MUST BE FLUSH EDGED TO PRESENT NEATLY USING ONE OF THE FOLLOWING TYPES OF EDGING: TIMBER: ACQ TREATED PINE 25MM WIDTH, OR HARDWOOD 10MM WIDTH. STEEL: ELECTRO-GALVANISED MILD STEEL EDGING 75-100MM DEPTH X 3-5MM WIDTH

- No more than 50% of the front garden is to comprise hard paved surfaces.
- The front garden must contain free draining surfaces such as:
 - » Grass (No artificial grass/turf allowed)
 - » Garden beds containing trees, shrubs, tufting plants
 - » Groundcovers
 - » River pebbles or Lilydale toppings or similar
 This reduces rain runoff and can keep the garden cooler in summer.

Consideration should be given to the cultivation of existing soil in the garden beds to a 200mm depth, the addition of imported topsoil and fertiliser to the garden bed, and the covering of the garden beds with pine bark or similar mulch.

4. All garden bed areas within the front yard must be edged using brick, timber, or steel edges

5. At least one tree with a minimum installation height of 2.0m must be planted between the front building line and street boundary.

KEY	Botanical Name	Common Name	Pot Size	Mature HxW	QTY
TREES	APO	Acer Palmatum Osakazuki	40ltrs min 1.6m High	5m x 4m	
	AH	Angophora hispida	40ltrs min 1.6m High	8m x 6m	
SHRUBS	CDB	Correa 'Dusky Bells'	200mm	0.6 x 1.0	9
	CS	Crowea Saligna	200mm	1.2m x .9m	
	FR	Fruticosa	200mm	0.6 x 0.50	8
GROUND COVER	AP	Anigozanthos pulcherrimus - Bush Noon	140mm	1.2m x .06m	
	LT	Lomandra longifolia - Tanika	140mm	.75m x .75m	



REVISIONS:

Address: UNIT 7
 133-143 ELGAR ROAD, DERRIMUT
 email: admin@gurubuildinggroup.com.au
 Phone: 0405402789

GURU BUILDING GROUP

PROJECT: PROPOSED RESIDENCE & GARAGE
 ADDRESS: LOT 1539, 11 FENWICK STREET, TARNEIT 3029


DRAWING STATUS: WORKING DRAWING
 TITLE: LANDSCAPE
 ISSUE: 1

CLIENT: AVISTA HOMES

DATE: 19/04/24
 SCALE: 1:100
 PAGE: 10
 SHEET SIZE: A3
 DRW. NUMBER: 20459

ARTIFICIAL LIGHTING CALCULATION
 9W MAX PER DOWNLIGHT
 40W MAX PER FLURO
 DWELLING (5W/M2) 803.70W
 GARAGE (3W/M2) 111.18W
 PORCH/OUTDOOR (4W/M2) 48.28W

BAL LEVEL: 12.5

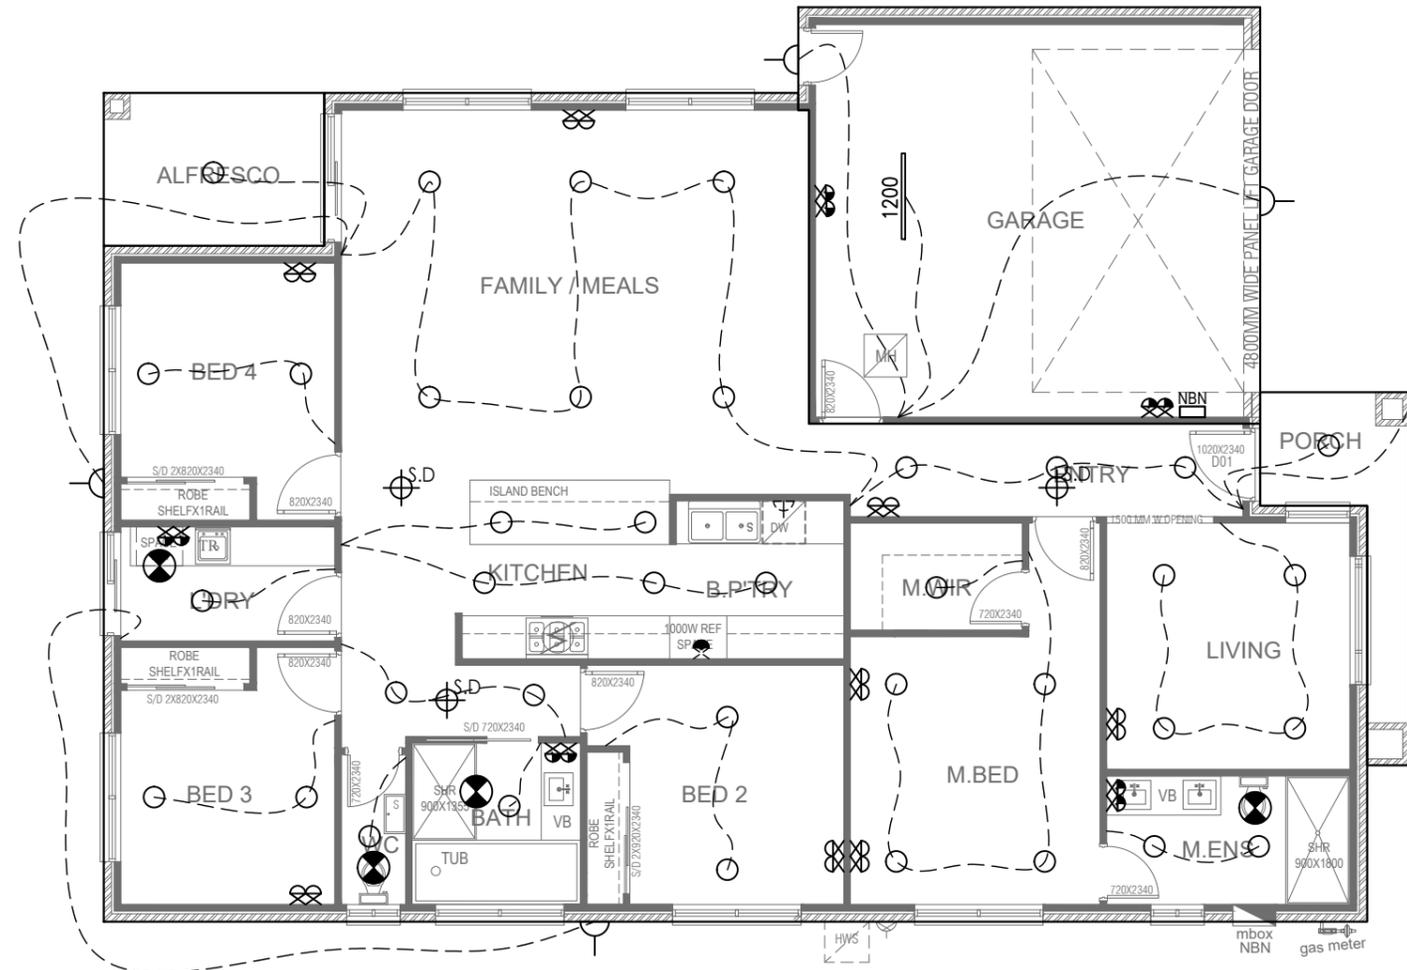

HEATING LEGEND	
⊕	CEILING HEATING DUCT
⊗	HEATING UNIT (APPROX. LOCATION ONLY)
⊙	DATA POINT
⊖	THERMOSTAT
▼	RETURN AIR
⌈	EVAPORATIVE COOLING DUCT
⌊	COOLING UNIT

ELECTRICAL PLAN 1:100


LIGHTING LEGEND		JUNCTION BOX-1800mm ABOVE F.L. UNLESS NOTED OTHERWISE	
○	DOWNLIGHT LED 5W/EACH	1200	1200 FLURO - SINGLE
⊗	LOW VOLTAGE DOWNLIGHT 5W/EACH	1200	1200 FLURO - DOUBLE
⊗	BATTEN HOLDER	○	WALL LIGHT BATTEN HOLDER
◐	WALL LIGHT	X	DIMMER LIGHT SWITCH
⊙	HEATER/FAN & LIGHT - 2 GLOBE	⊗	SECURITY SENSOR
⊙	HEATER/FAN & LIGHT - 4 GLOBE	⊗	CEILING EXHAUST FAN (SELF-SEALING)
		⊗	CEILING EXHAUST FAN SWITCHED WITH LIGHT (SELF-SEALING)

POWER LEGEND	
⊗	SINGLE GPO - 300mm
⊗	SINGLE GPO - 1100mm
⊗	SINGLE GPO - 1350mm
⊗	SINGLE GPO - EXTERNAL
⊗	SINGLE GPO - FOR DISHWASHER
⊗	SINGLE GPO - FOR MICROWAVE
⊗	SINGLE GPO - FOR SECURITY SYS.
⊗	UBO & RHOD CONNECTIONS

⊗	DOUBLE GPO - 300mm
⊗	DOUBLE GPO - 1100mm
⊗	DOUBLE GPO - 1350mm
▽	TELEVISION POINT
⊕	CAPPED GAS POINT
⊕	SMOKE DETECTOR
⊕	METER BOX
⊕	SECURITY SYSTEM KEYPAD LOCATION
⊕	TELEPHONE POINT

NOTE:
 LOCATION OF ALL ELECTRICAL & SERVICE POINTS ARE APPROXIMATE ONLY, AND ARE SUBJECT TO POSITION OF STRUCTURAL MEMBERS ON PLAN.

REVISIONS:



GURU BUILDING GROUP


Address: UNIT 7
 133-143 ELGAR ROAD, DERRIMUT
 email: admin@gurubuildinggroup.com.au
 Phone: 0405402789

PROJECT: PROPOSED RESIDENCE & GARAGE
 ADDRESS: LOT 1539,11 FENWICK STREET,TARNEIT 3029

CLIENT: AVISTA HOMES


DRAWING STATUS: WORKING DRAWING	TITLE ELECTRICAL	ISSUE 1	DRAWN	DATE 19/04/24	SHEET SIZE A3
			CHECKED	PAGE 11	

BAL LEVEL: 12.5

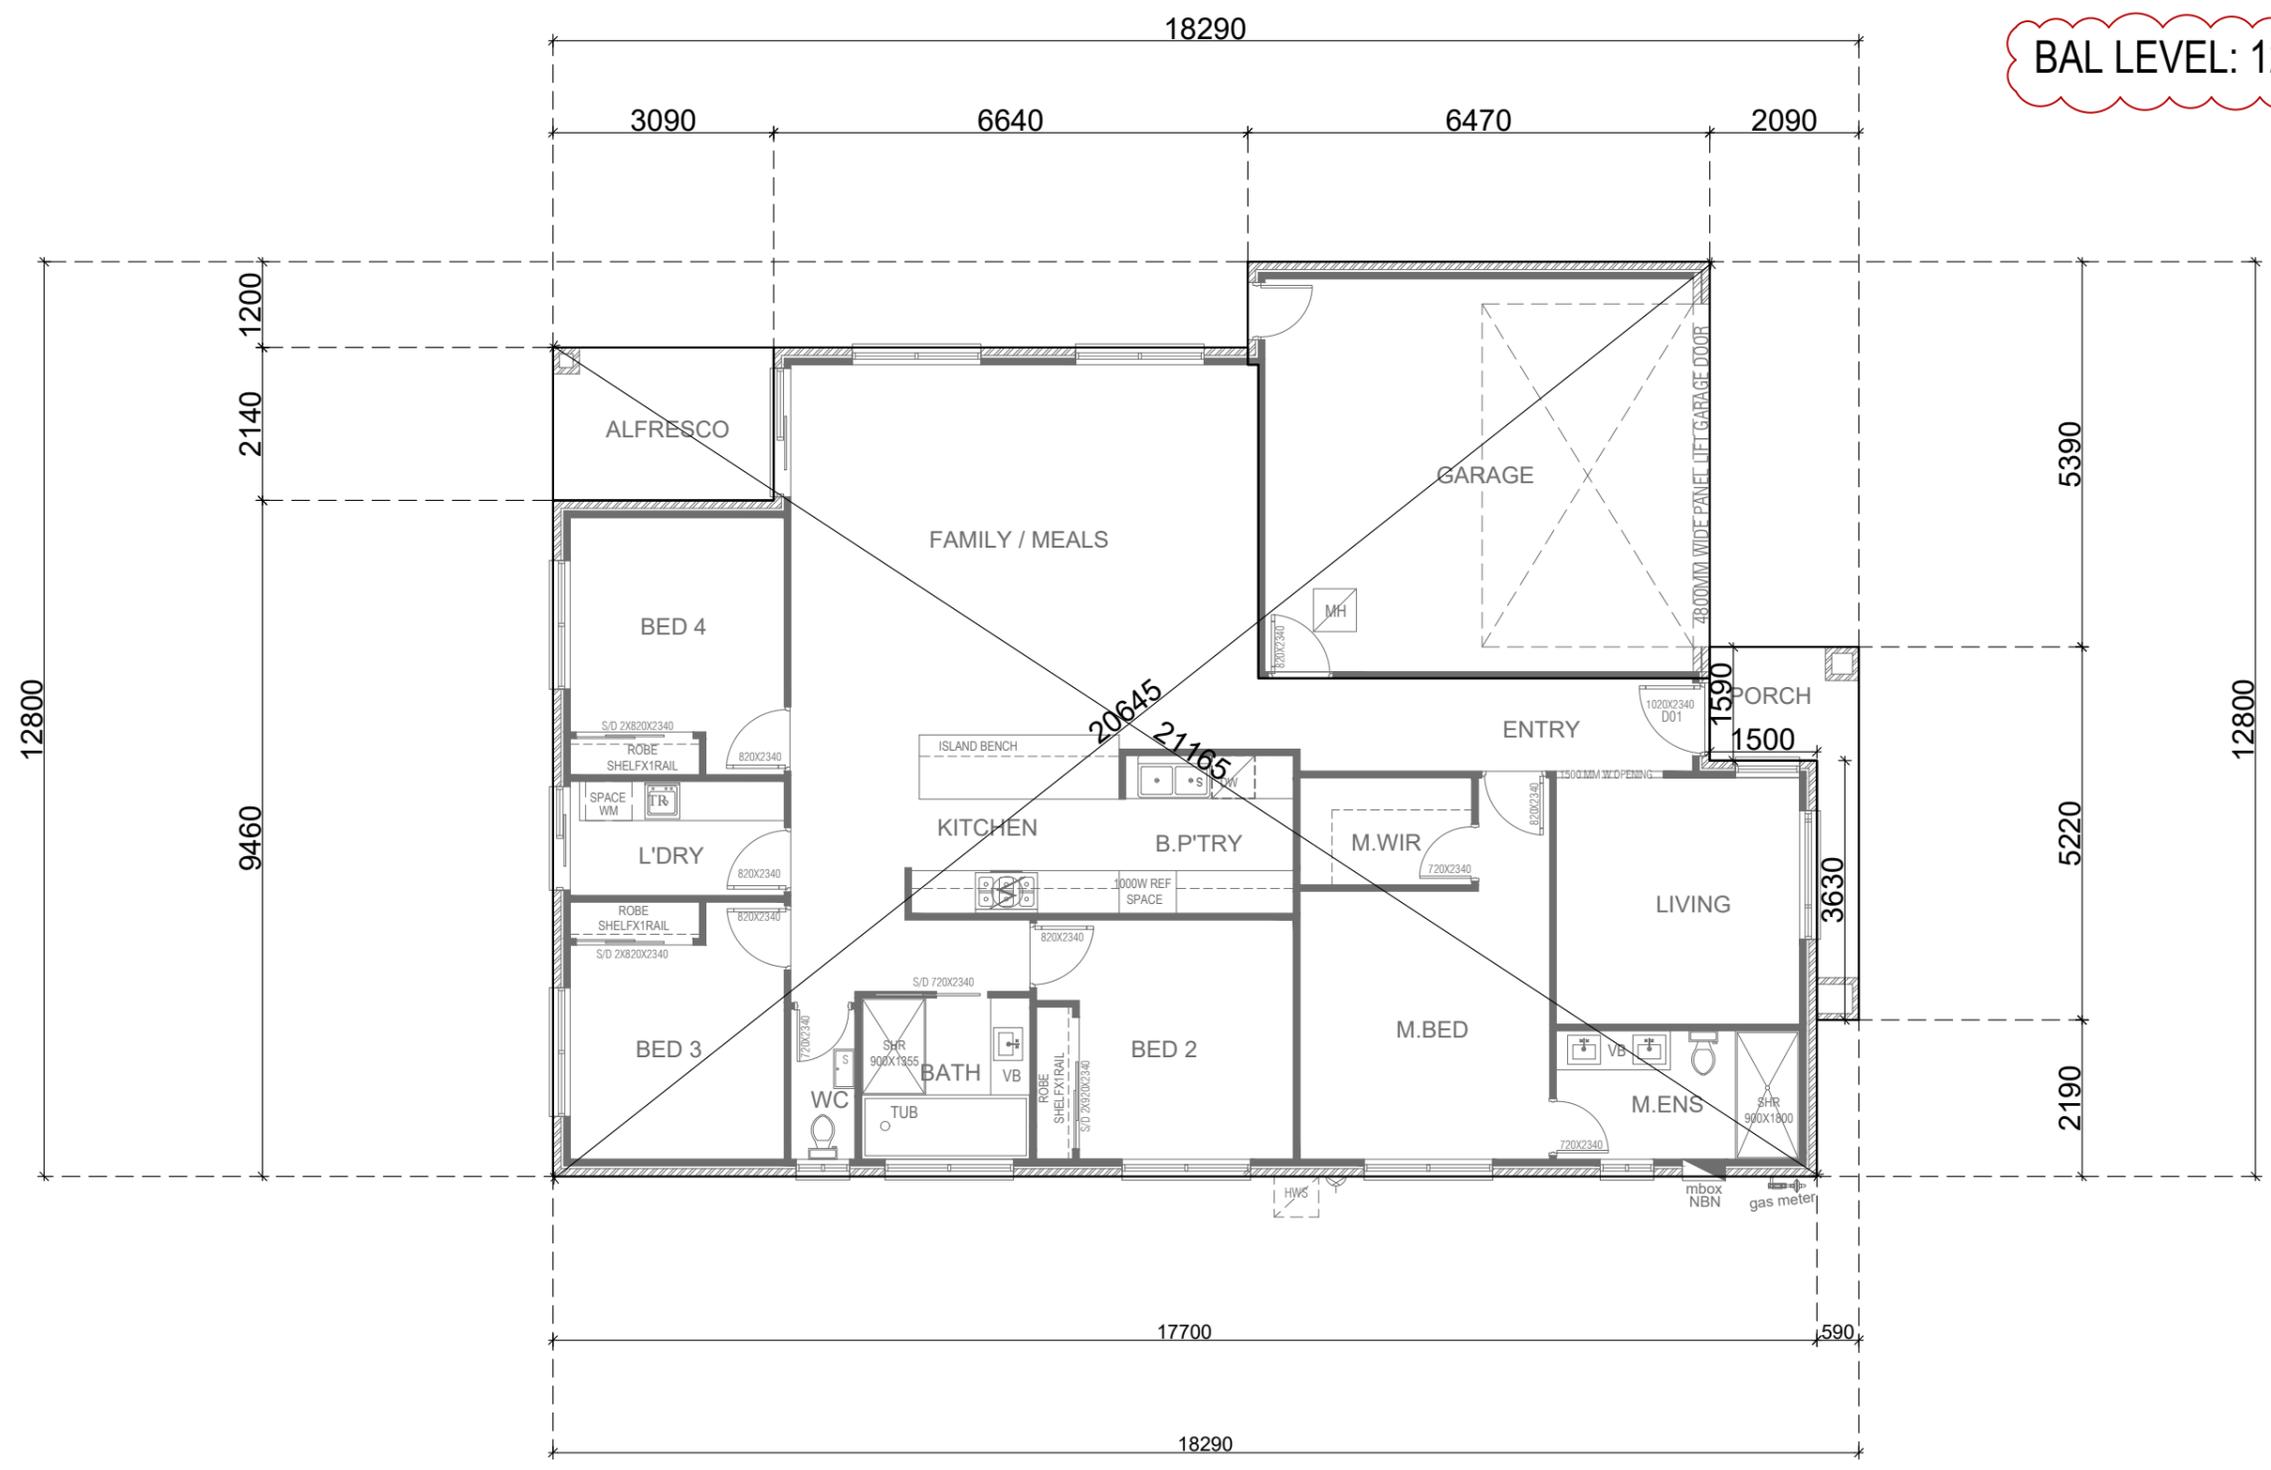

SET OUT PLAN 1:100

REVISIONS:




GURU BUILDING GROUP
 Address: UNIT 7
 133-143 ELGAR ROAD, DERRIMUT
 email: admin@gurubuildinggroup.com.au
 Phone: 0405402789

PROJECT: PROPOSED RESIDENCE & GARAGE
 ADDRESS: LOT 1539,11 FENWICK STREET, TARNEIT 3029
 DRAWING STATUS: WORKING DRAWING
 TITLE: SLAB PLAN
 ISSUE: 1


CLIENT: AVISTA HOMES
 DRAWN: DATE 19/04/24
 SCALE: 1:100
 CHECKED: PAGE 12
 DRW. NUMBER: 20459
 SHEET SIZE: A3

BAL LEVEL: 12.5

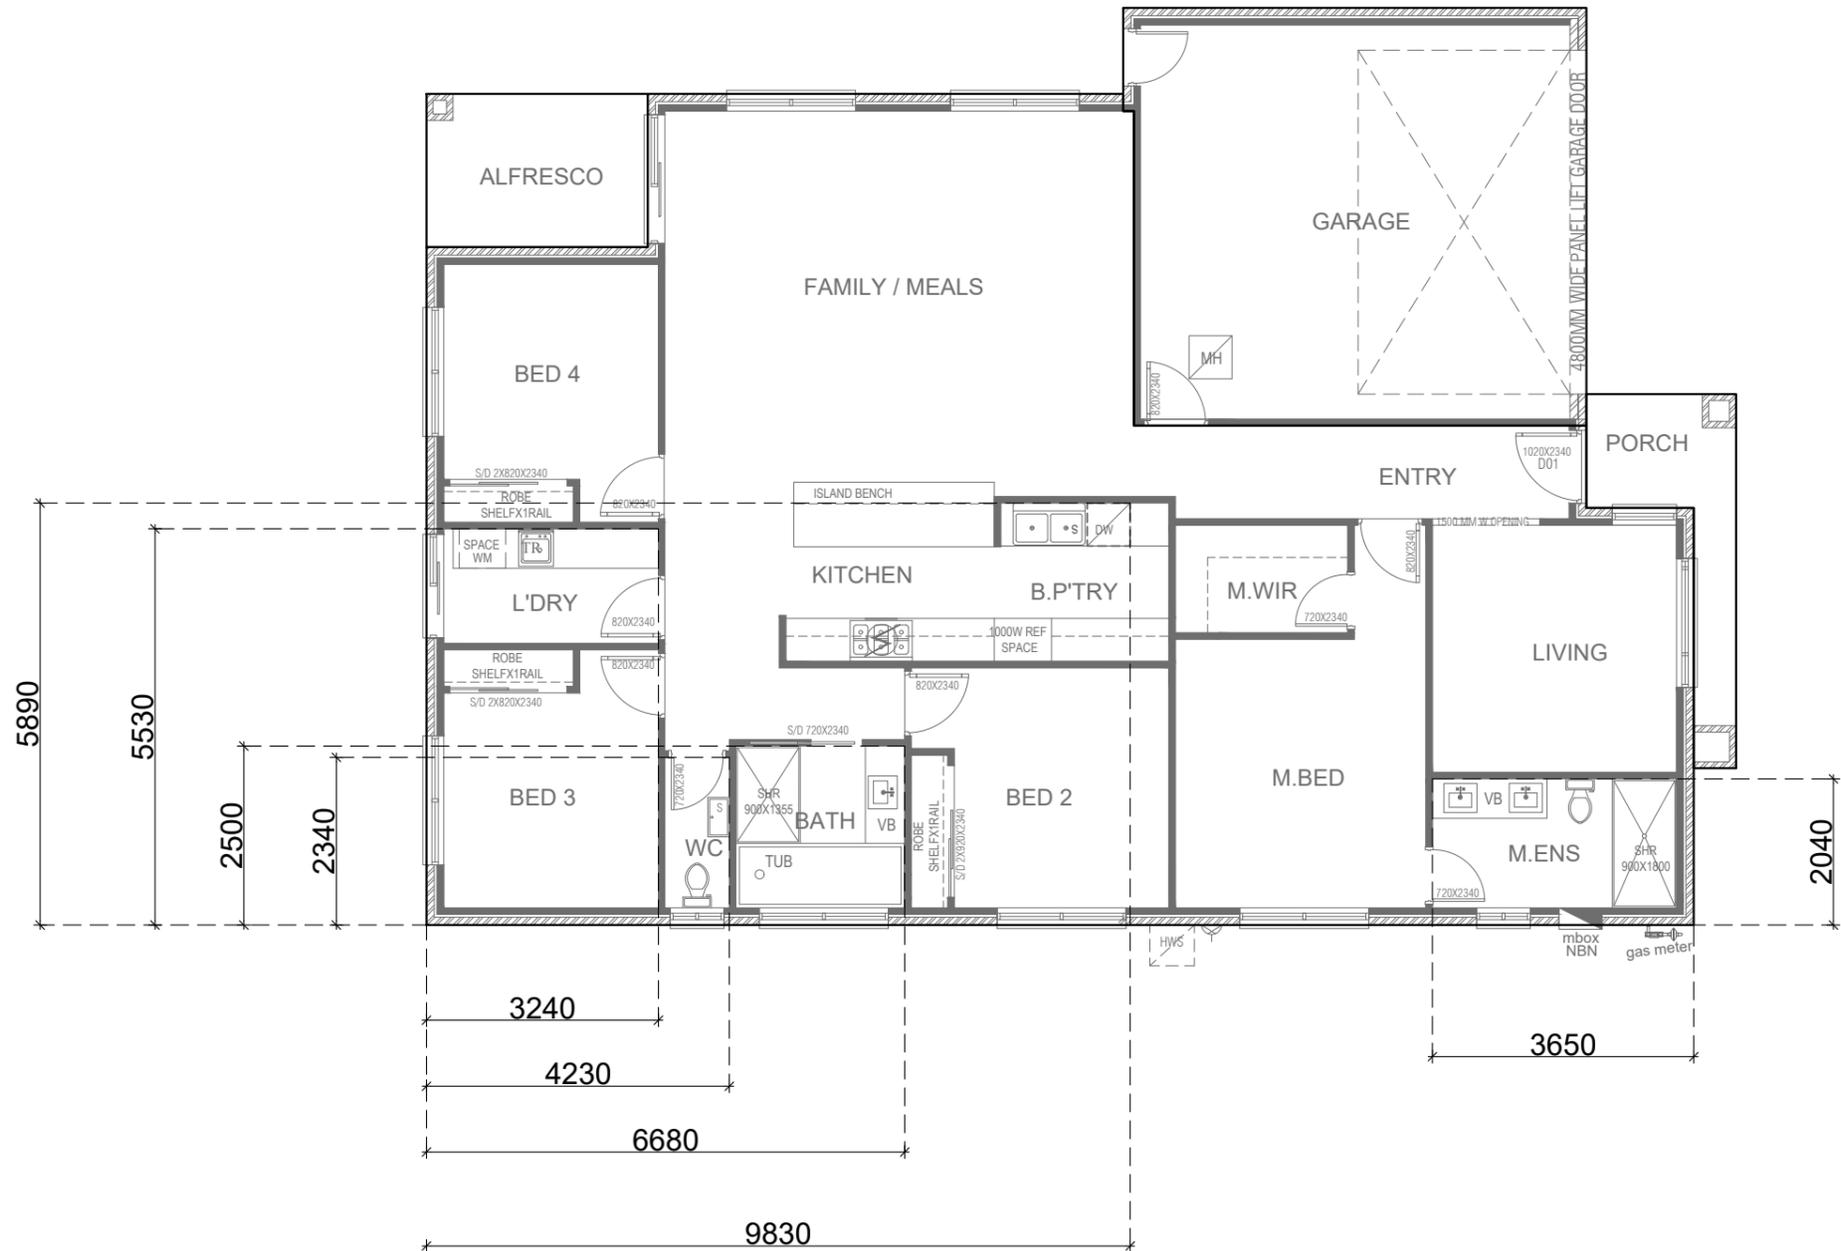

HYDRAULIC PLAN 1:100

REVISIONS:



GURU BUILDING GROUP
 Address: UNIT 7
 133-143 ELGAR ROAD, DERRIMUT
 email: admin@gurubuildinggroup.com.au
 Phone: 0405402789

PROJECT: PROPOSED RESIDENCE & GARAGE
 ADDRESS: LOT 1539,11 FENWICK STREET,TARNEIT 3029
 DRAWING STATUS: WORKING DRAWING
 TITLE: HYDRAULIC
 ISSUE: 1

CLIENT: AVISTA HOMES
 DRAWN: DATE 19/04/24
 SCALE: 1:100
 CHECKED: PAGE 13
 DRW. NUMBER: 20459
 SHEET SIZE: A3

